

QuickSetter+™ Low-lead balancing valve with flow meter, NPT male connections



Submittal Data 02164-25 NA — Issue Date 03/2025

Application

The QuickSetter+™ manual balancing valve contains a built-in flow meter and sight gauge, negating the need for differential pressure gauges and reference charts. Circuit balancing is fast, easy and accurate. Constructed of low-lead brass, QuickSetter+™ is ideally suited for use in plumbing applications such as hot water recirculation systems. The built-in check valve protects against circuit thermo-siphoning. The outlet temperature gauge (optional) verifies the fluid temperature in the circuit. The flow meter sight gauge is dry (not exposed to the fluid) thus eliminating the possibility of gauge clouding/scaling over time. Low-lead ball valves available separately, field install.

Typical Specification

Furnish and install on the plans and described herein, a Caleffi QuickSetter+™ balancing valve with flow meter as manufactured by Caleffi. Each balancing valve must be designed with DZR low-lead brass body (<0.25% Lead content) certified by ICC-ES, stainless steel ball, chrome-plated brass ball control stem, PTFE ball seal seat, PSU control stem guide, DZR low-lead brass flow meter body and headwork, stainless steel flow meter bypass valve stem, stainless steel flow meter springs, PSU flow meter float and indicator cover, peroxide-cured EPDM seals, and provided complete with inlet flow check valve. Can be provided with optional mixed outlet dual-scale temperature gauge, 32 - 210 F (0 - 100 °C) scale, 2 inch diameter. Provide with optional inlet and outlet isolation ball valves, code 290030 or 290031, separately sourced, field installed. Provide with optional insulation sleeve, code F0000926, separately sourced. Each balancing valve shall be a Caleffi model 132 or approved equal. (See product instructions for specific installation information.)

Technical Data

Materials Valve

Body: DZR low-lead* brass
Ball: stainless steel
Ball control stem: brass, chrome plated
Ball seal seat: PTFE
Control stem guide: PSU
Seals: peroxide-cured EPDM

Flow meter

Body and headwork: DZR low-lead brass
Bypass valve stem: stainless steel
Springs: stainless steel
Seals: peroxide-cured EPDM


Flow meter float and indicator cover: PSU
* Meets the "lead free" requirement of Section 1417 of the Safe Drinking Water Act (SDWA). This product has a weighted average lead content of less than 0.25% for its wetted surfaces contacted with consumable water. Complies with NSF/ANSI/CAN 372, Drinking Water System Components-Lead Content Reduction of Lead in Drinking Water Act, California Health and Safety Code 116875 S.3874, Reduction in Drinking Water Act, as certified by ICC-ES, file PMG-1360.

Performance

Suitable Fluids: water, glycol solutions
Max. percentage of glycol: 50%
Max. working pressure: 150 psi (10 bar)
Working temperature range: 14 - 230 °F (-10 -110 °C)
Flow rate range unit of measurement: 1/2 - 1 3/4 gpm; 2 - 7 gpm
Accuracy: ±10%
Control stem angle of rotation: 90 °
Control stem adjustment wrench: 9 mm
NPT male union connections: 1/2", 3/4", 1"

We reserve the right to change our products and their relevant technical data, contained in this publication, at any time and without prior notice. Contractors should request production drawings if prefabricating the system

Dimensions

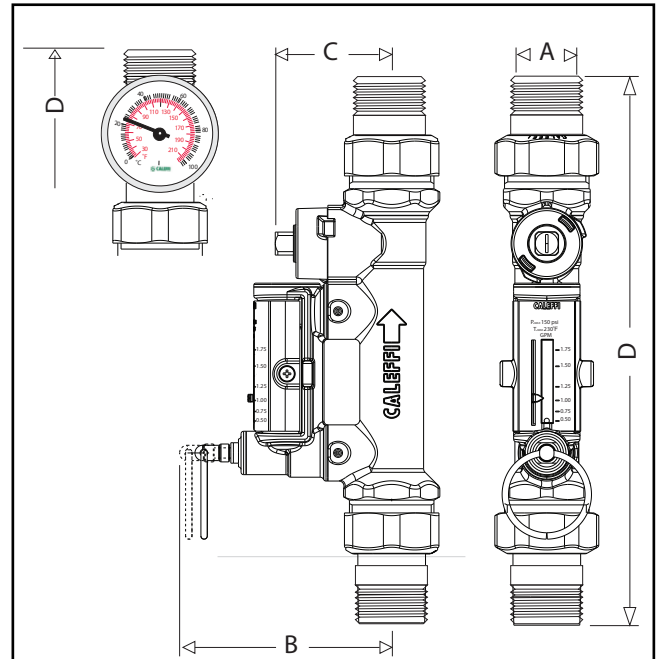

Code	A	B	C	D	Wt (lb)
Flow scale: 1/2 to 1 3/4 gpm					
132430AFC	1/2"	3 5/16"	1 13/16"	8 3/4"	1.80
132530AFC	3/4"			8 5/16"	2.00
132630AFC	1"			8 3/4"	2.40
132431AFC*	1/2"			10 15/16"	1.80
132531AFC*	3/4"			10 1/2"	2.00
132631AFC*	1"			10 15/16"	2.40

Code	A	B	C	D	Wt (lb)
Flow scale: 2 to 7 gpm					
132450AFC*	1/2"	3 5/16"	1 13/16"	8 3/4"	2.40
132550AFC*	3/4"			8 5/16"	2.60
132650AFC*	1"			8 3/4"	2.80
132451AFC*	1/2"			10 15/16"	2.40
132551AFC*	3/4"			10 1/2"	2.60
132651AFC*	1"			10 15/16"	2.80

*with dual-scale temperature gauge 32 - 210 °F (0 - 100 °C).

Job name _____
Job location _____
Engineer _____
Mechanical contractor _____
Contractor's P.O. No. _____
Representative _____

Size _____
Quantity _____
Approval _____
Service _____
Tag No. _____
Notes _____