

Flo-Set™

Variable orifice balancing valve

142 Series

Submittal Data 02189-26 NA — Issue Date 04/2026



Application

Flo-Set™ 142 series manual balancing valves are used in hydronic heating and cooling systems, domestic hot water recirculation loops, and other closed or open fluid distribution systems requiring accurate flow balancing and adjustment. They are installed at terminal units, branch lines, or risers to ensure proper distribution of flow, optimize system efficiency, and maintain designed operating conditions. Typical applications include fan coil units, air handling units, heat exchangers, radiant heating manifolds, and domestic hot water return piping.

Typical Specification

Furnish and install, as shown on the plans, a Flo-Set™ 142 series manual balancing valve with variable venturi orifice as manufactured by Caleffi. Each valve shall have NPT female threaded connections in sizes ½", ¾", 1", 1 ¼", 1 ½", and 2". The valve body, bonnet, and control stem shall be constructed of DZR low-lead brass (<0.25% lead content) and certified to NSF/ANSI/CAN 372 by ICC-ES. The valve plug shall be stainless steel. The stem shall incorporate a PTFE guide bearing and brass seal seat with peroxide-cured EPDM hydraulic seals. The adjusting knob shall be PA6G30 with integral memory stop. Pressure test ports shall be DZR low-lead brass with EPDM seal elements. The valve shall be suitable for water or water/glycol solutions up to 50% concentration, with a maximum working pressure of 232 psi (16 bar) and a working temperature range of 15 to 250 °F (-10 to 120 °C). The valve shall have four adjustment turns and a flow measurement accuracy of ±15%. Pre-formed insulation shells shall be available for field installation. Optional inlet and outlet isolation may be provided by full-port low-lead brass ball valves, if so Caleffi NA108 series, NPT female x NPT female, with low-lead close nipples shall be used. Each valve shall be Caleffi 142 series or approved equal. (See product instructions for detailed installation requirements.)

Certification

NSF/ANSI/CAN 372, US and Canadian Low-Lead and Lead-Free materials contents laws for drinking water system components. Certified by ICC-ES, PMG File 1360.



Technical specifications

Materials

Body:	DZR low-lead brass
Bonnet:	DZR low-lead brass
Valve adjustment plug:	DZR low-lead brass
Hydraulic seals:	Peroxide-cured EPDM
Adjustment knob:	PA6G30
Pressure test ports:	DZR low-lead brass body, EPDM seal elements
Insulation:	EPP

Performance

Suitable fluids:	Water, glycol solution
Max. percentage of glycol:	50%
Max. working pressure:	232 psi (16 bar)
Working temperature range:	15 - 250°F (-10 - 120 °C)
Accuracy:	±15%
Number of adjustment turns:	4
Number of regulating positions:	8


Insulation:

Thickness:	½" (15 mm)
Density:	2.8 lb/ft³ (45 kg/m³)
Thermal conductivity (ISO 2581):	- at 50°F (10°C): BTU · in/hr · ft² · °F (0.037 W/m · K)
Working temperature range:	23 - 250°F (-5 - 120°C)
Reaction to fire (UL 94):	Class HBF

Connections:

Valve body:	½", ¾", 1", 1 ¼", 1 ½", 2" NPT female
Pressure test ports:	¼" NPT female

Dimensions

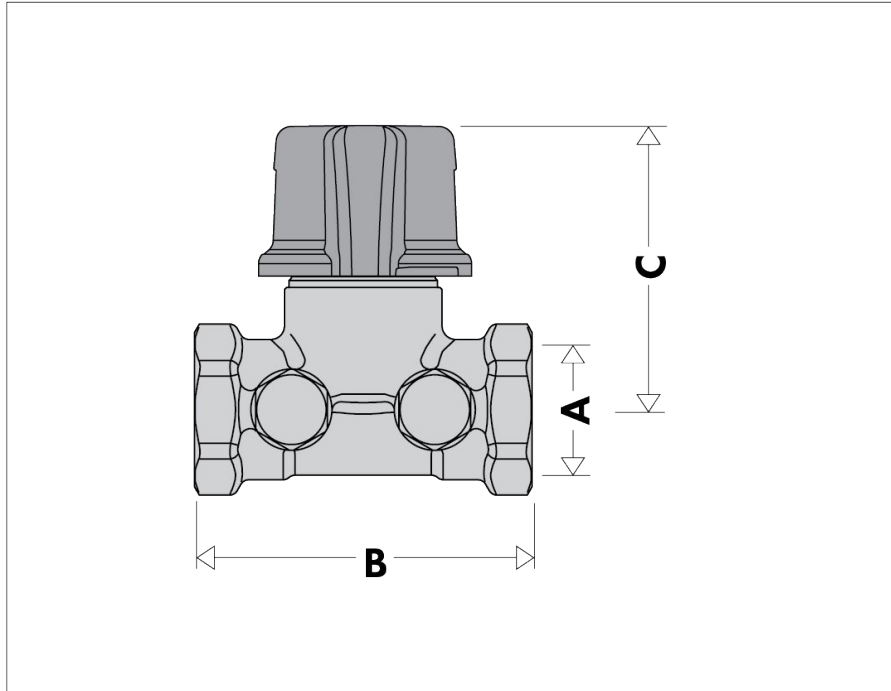

Code	A	B	C	Wt (lb)
142241A	1/2"	2 9/16"	2 1/2"	1.0
142251A	3/4"	2 15/16"	2 1/2"	1.2
142261A	1"	3 7/16"	2 1/2"	1.5
142271A	1 1/4"	3 3/4"	3 1/4"	2.3
142281A	1 1/2"	3 15/16"	3 3/8"	3.0
142291A	2"	4 3/4"	3 3/8"	3.5

We reserve the right to change our products and their relevant technical data, contained in this publication, at any time and without prior notice. Contractors should request production drawings if prefabricating the system

Job name _____	Size _____
Job location _____	Quantity _____
Engineer _____	Approval _____
Mechanical contractor _____	Service _____
Contractor's P.O. No. _____	Tag No. _____
Representative _____	Notes _____