# **BACKFLOW PREVENTION DEVICES**









# FLOWING EXPERTISE

With our heating and plumbing solutions, we have been redesigning the comfort of the spaces we live and work in for over 60 years. This is thanks to the flow of expertise, technology, experience and innovations that we have acquired over the years by constantly exchanging ideas with our customers and suppliers. A flow that pushes boundaries, allowing us to constantly set the benchmark. A flow that allows us to always look one step ahead into the future.



FLOW OF LIFE

A unique way of flowing. It is **continuous change**, a high degree of reliability in our work, and the ongoing pursuit of total quality, which is the result of small everyday actions.



FUTURE

Innovation aimed at creating **new** forms of comfort for spaces, which motivates us to continue to grow and improve.



SUSTAINABILITY

Our focus on preserving environmental, social and economic well-being so that it can be passed on to future generations through our products and processes.



TECHNOLOGY

Our ability to do research, invest in processes and develop **state-of-the-art solutions** in an ever-evolving world of expertise.



MADE IN CALEFFI

A uniqueness consisting of many details, which is what we are known for worldwide. True "Made in Italy" quality, the hallmark of our company.



## HISTORIC BRAND

With over 60 years' experience in the industry, we have been included in the special register of historic brands of national interest.

We are proud of our place in Italian history.



# T R A I N I N G

We have always invested in customer training and contributed to boosting know-how within the sector. CALEFFI EXPERIENCE is the result of this commitment, acting as a single umbrella under which a long list of training activities are brought into effect. First there was the wealth of technical documentation (including this brochure), and then came digital with product videos, constantly updated websites, Coffee with Caleffi webinars, apps, BIM libraries and 3D viewers.



SUBSCRIBE TO OUR FREE COFFEE WITH CALEFFI SESSIONS






FOLLOW OUR YOUTUBE CHANNEL







This Monographic Guide concerns the problem of pollution of water supplies from backflow and presents the range of Caleffi products specifically designed to prevent this problem.

The materials of the components and their performance characteristics meet the specific regulatory and safety requirements of water supply systems.

## **POLLUTION OF WATER SUPPLIES - NORMATIVE REFERENCES**

This Monographic Guide addresses the following topics:

- pollution of water supply systems and the relative reference standards for its prevention;
- classification and selection of backflow prevention devices according to the type of system and the medium present in downstream system;
- examples of system layouts with indication of points requiring protection using suitable pollution prevention devices;
- presentation of Caleffi products with information on installation, maintenance and functional testing.

Pollution is defined as any relative degradation of the quality of potable water.

European standard **EN 1717:2000** "Protection against pollution of potable water in water installations and general requirements of devices to prevent pollution by backflow" is the reference point as regards the prevention of pollution of public water supplies caused the backflow of medium from private systems downstream.

The above standard is applied in conjunction with the **EN 806:2012** series of standards, "Specifications for installations inside buildings conveying water for human consumption" that indicate the requirements for design, operation and maintenance.

Both these European reference standards should be applied in conjunction with the applicable national standards and regulations. Installations must be designed and maintained in such a way that they do not cause contamination of the public water supply or of the internal system by backflow of any type of substance considered hazardous.

The standard EN 1717 classifies the water contained in installations into five categories according to the degree of risk they pose to human health; these categories range from 1, with no human health hazard, to 5, the most hazardous.

### Category 1:

Water to be used for human consumption coming directly from a potable water distribution system.

#### Category 2:

Medium presenting no human health hazard, as per 1, the quality of which can have undergone a change in taste, odour, colour or temperature.

#### Category 3:

Medium presenting some human health hazard due to the presence of one or more harmful substances.

#### Category 4:

Medium presenting a human health hazard due to the presence of one or more "toxic" or "very toxic" substances or one or more radioactive, mutagenic or carcinogenic substances.

#### Category 5:

Medium presenting a human health hazard due to the presence of microbiological or viral elements.

According to this classification, suitable backflow prevention devices must be fitted in water distribution circuits.

EN 1717 lists the operating principle and minimum requirements of devices designed to protect the public water supply from the backflow of fluids belonging to one of these five categories.

Protection devices are grouped in eight Families, identified by the letters A, B, C, D, E, G, H, L, each of which may have one or more variants called Types, also identified with the letters A, B, C, or D. EN 1717 specifies for each Type of device the minimum and maximum medium category and the conditions in which it may be

#### used for to protect the installation against backflow.


The sequence of appliances, including protection device, filters, check valves, shut-off valves, pressure test ports, air gaps, etc. that together comprise the backflow protection, is known as the **Protection Unit**. The Protection Point is defined as the point in the system in which the Protection Unit is applied.

The generic symbol used in EN 1717 to identify the Protection Unit is a hexagon containing the letters indicating the protection Family and Type, as shown in the following figure:



Here below are some examples of Protection Units with the relative sequences of devices required by EN 1717.


Protection unit: Family B, Type A




Protection unit: Family C, Type Aa



Protection unit: Family E, Type A



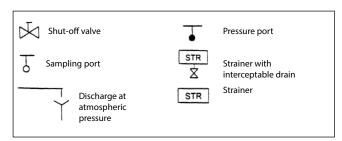

The indications in EN 1717 may be applied to all domestic, industrial/commercial and non domestic installations connected to the public potable water supply:

- domestic installations in residential or similar buildings, such as homes, hotels, schools, offices, hostels, etc.: kitchen sinks, hand basins, baths, showers, WCs, domestic hot water systems, domestic washing machines and dishwashers, bidets, garden irrigation systems, systems with low concentrations of additives that are not harmful to human health, such as water treatment, airconditioning systems, etc.;
- in industrial and commercial installations the standard applies to all applications of potable water with similar use to a domestic installation, excluding therefore process water; also fire fighting, centralised heating or irrigation systems;
- non domestic installations for professional uses of water, for example, industries, commerce, agriculture, clinics, public and private swimming pools and thermal baths.


EN 1717 is used as the main reference in the preparation of the relative product standards, or is used directly in the absence of specific product standards.

# **POLLUTION OF WATER SUPPLIES - NORMATIVE REFERENCES**

#### **Backflow**

Potable water from the mains supply may be subject to pollution caused mainly by the contaminated medium flowing back from plumbing installations connected directly to the mains supply. Backflow can be attributed to a variation in the pressure difference that causes a consequent inversion of the normal direction of flow at certain point of the installation. This phenomenon, termed "back flow", occurs when: a) the pressure in the mains system is less than that in the plumbing circuit receiving the supply (back syphonage). This situation can occur, for example, due to a break in the pipework of the mains supply and the consequent maintenance work, or when significant quantities of water are drawn by other users connected upstream, such as fire-fighting

b) the pressure in the plumbing circuit receiving the supply rises (counter pressure) due, for example, to water being pumped from a well.

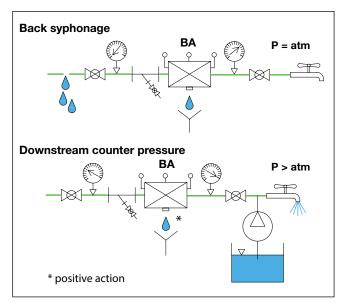

#### Risk assessment

Given the potential dangers of the phenomenon and the requirements of current legislation, a risk assessment of backflow pollution must be carried out on the basis of the type of system and the characteristics of the medium that flows inside it.

A suitable backflow prevention device must be selected on the basis of the assessment performed by the system designer and the mains supplier. The device must be located along the internal distribution system at the points at risk of backflow which would be hazardous to human health.

In addition to consultation of the European standard EN 1717, it is always necessary to consult the water supplier and the specific national regulations as, depending the type of installation, there may be more restrictive or more permissive derogations from the European standard.

In situations where there are mediums present that pose different degrees of hazard, backflow prevention should consider the most hazardous of these mediums. In the case of mediums that are exceptionally hazardous, it will be necessary to assess additional technical parameters.

In the case of applications where it is not possible to verify the risk level, it is necessary to hypothesise the greatest risk. The "Protection Matrix" tables reported in the following pages list various types of installation and the corresponding medium categories.

### Protection Unit - Product standards - Caleffi devices

Tables 1 and 2 below list all the Protection Units defined in EN 1717. with the relative medium categories, the product standards and the corresponding products in the Caleffi catalogue.

Table 2						
Devices	Category	Authorised level of the Protection Unit				
Tap with spray head over washbasins, sinks, showers, baths; excluding WCs and bidets	5	Protection unit for category 2 and EB, ED, HC				
Tub with water inlet below the rim of the tub (b)	5	Protection unit for category 3				
Rubber hose attachment outlet (a b)	5	Protection unit for category 3				
Overground or in-ground irrigation system (b)	5	Protection unit for category 4				

(a) Used for washing, cleaning or garden irrigation (b) The Protection Unit must be installed above the maximum operating level

\* Not confirmed

Table 1		N	∕lediu	ms ca	ategor	У		
Family Type	Protection unit EN 1717	1	2	3	4	5	Product standard	Caleffi series
AA	Unrestricted backflow preventers	*	•	•	•	•	EN 13076	
AB	Backflow preventers with non-circular overflow (unrestricted)	*	•	•	•	•	EN 13077	
AC	Backflow preventers with submerged inlet comprising an air inlet and overflow	*	•	•	-	-	EN 13078	
AD	Backflow preventers with injector	*	•	•	•	•	EN 13079	
AF	Air gap with circular overflow (restricted)	*	•	•	•	-	EN 14622	
AG	Air gap with minimum circular overflow (verifiable by test or measurement)	*	•	•	-	-	EN 14623	
BA	Verifiable backflow preventers with reduced pressure zone	•	•	•	•	-	EN 12729	580, 574, 575
CA	Non-verifiable backflow preventers with different pressure zones   • •		•	-	-	EN 14367	573	
DA	In-line anti-vacuum valves from DN 8 to DN 80		0	0	-	-	EN 14451	
DB	Pipe interrupter with atmospheric vent and moving element from DN 10 to DN 20	0	0	0	0	-	EN 14452	
DC	Pipe interrupter with permanent atmospheric vent from DN 10 to DN 20	0	0	0	0	0	EN 14453	
EA	Controllable anti-pollution check valves from DN 6 to DN 250	•	•	-	-	-	EN 13959	3045, 3046
EB	Non-controllable anti-pollution check valves from DN 6 to DN 250				EN 13959	3047		
EC	Controllable anti-pollution double check valves from DN 6 to DN 250	•	•	-	-	-	EN 13959	
ED	Non-controllable anti-pollution double check valves from DN 6 to DN 250						EN 13959	
GA	Direct controlled mechanical backflow preventer	•	•	•	-	-	EN 13433*	
GB	Hydraulically controlled mechanical backflow preventer	•	•	•	•	-	EN 13434*	
НА	Vacuum breaker with pipe fitting from DN 15 to DN 32	•	•	0	-	-	EN 14454	
НВ	Anti-vacuum valves with pipe fitting from DN 15 to DN 25 inclusive	0	0	-	-	-	EN 15096	
HC	HC Automatic diverter ■					EN 14506		
HD	Anti-vacuum valves with pipe fitting from DN 15 to DN 25 inclusive	•	•	0	-	-	EN 15096	
LA	Pressurised air inlet valves from DN 15 to DN 50	0	0	-	-	-	EN 14455	
LB	Pressurised air inlet valves from DN 15 to DN 50	1.	•	0	-	-	EN 14455	

# **POLLUTION OF WATER SUPPLIES - NORMATIVE REFERENCES**

The following table presents the graphic symbols of the Protection Units and the design principles of the devices listed by EN 1717.

Family Type	Protection unit EN 1717	Protection unit: graphic symbol	Design principle
AA	Unrestricted backflow preventers	*	
АВ	Backflow preventers with non-circular overflow (unrestricted)	*1	
AC	Backflow preventers with submerged inlet comprising an air inlet and overflow	Y	
AD	Backflow preventers with injector	****	
AF	Air gap with circular overflow (restricted)	<b>₩</b> ,	
AG	Air gap with minimum circular overflow (verifiable by test or measurement)	Y.	
ВА	Verifiable backflow preventers with reduced pressure zone	¥ Ş X	
CA	Non-verifiable backflow preventers with different pressure zones	<b>₹</b>	P1 P2
DA	In-line anti-vacuum valves from DN 8 to DN 80		
DB	Pipe interrupter with atmospheric vent and moving element from DN 10 to DN 20	\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	
DC	Pipe interrupter with permanent atmospheric vent from DN 10 to DN 20	<del>\</del> \\   \	

# POLLUTION OF WATER SUPPLIES - NORMATIVE REFERENCES

EA	Controllable anti-pollution check valves from DN 6 to DN 250	<b>→</b>	ood ood oo
ЕВ	Non-controllable anti- pollution check valves from DN 6 to DN 250		age -
EC	Controllable anti-pollution double check valves from DN 6 to DN 250	- <del>-</del> <del>-</del> <del>-</del> <del>-</del> <del>-</del> <del>-</del> <del>-</del> - <del>-</del> <del>-</del> - <del>-</del> - <del>-</del> - <del></del>	
ED	Non-controllable anti- pollution double check valves from DN 6 to DN 250	<b>−</b> Ď	
GA	Direct controlled mechanical backflow preventer	-VISTR	
GB	Hydraulically controlled me- chanical backflow preventer	₩ STR	
НА	Vacuum breaker with pipe fitting from DN 15 to DN 32	→ <b>▼</b>	
НВ	Anti-vacuum valves with pipe fitting from DN 15 to DN 25 inclusive	-□ <b>Z</b>	
НС	Automatic diverter	— <del>****</del>	
HD	Anti-vacuum valves with pipe fitting from DN 15 to DN 25 inclusive	→ ↓ <u> </u>	
LA	Pressurised air inlet valves from DN 15 to DN 50		
LB	Pressurised air inlet valves from DN 15 to DN 50		

# **PROTECTION MATRIX**

The following table, the "Protection Matrix", lists a series of installations arranged according to type.

For each installation type, the table indicates the risk category of the medium contained. The categories range from 2 to 5 according the hazard posed to human health, as defined in EN 1717.

The table has been drawn up on the basis of the indications provided by European standard EN 1717 and national regulations. The table is not comprehensive, and checks should conducted at the time of application to ensure compliance with any local standards or regulations. Some installations are represented in the diagrams on the following pages.


Type of installation			um	
	2 3 4			5
General				
Hot and cold water mixing devices in domestic water systems (see diagrams n° 1, 2, 3 and 4)	х			
Water cooling devices for air conditioning units, without additives	х			
Filling of heating systems, without additives (see diagrams n° 10, 11 and 12)		х		
Filling of heating systems, with additives (see diagram n° 13)			х	
WC: filling of tank with float			х	
Filling of forced circulation solar thermal systems			х	
Domestic water softeners regenerated with common salt	х			
Commercial water softeners (only regenerated with common salt) (see diagram n° 15)		х		
Filling of closed circuits with dosing devices for additives such as softeners or demineralisers (see diagram n° 14)			х	
Toilet cleaning systems with chemicals and disinfectants			х	
Bathtub filling and cleaning system with water outlet below the edge of the tub (immersed)			х	
Hand held showers for baths or sinks (see diagram n° 6)				х
Filling of swimming pools			х	
Hairdressers' shampoo basins			х	
Pillar taps (not mixer taps) for sinks, washbasins, bidets	х			
Sprinkler fire fighting systems with antifreeze solutions (see diagram n° 23)			х	
Water in sinks, baths and showers (see diagram n° 5)				х
Domestic dishwashers and washing machines (see diagram n° 17)		х		
Industrial tanks				Х


Type of installation	Medium category			
	2	3	4	5
Taps for non domestic applications with connection pipe				х
Permeable pipes not for garden use, laid underground or on the ground with or without chemical additives				х
Reclassified water systems				Х
Urinals, WCs and bidets (see diagrams n° 7, 8 and 9)				х
Domestic or residential gardens				
Hand-held fertiliser sprayers for use in domestic gardens		Х		
Mini-irrigation systems, without fertilisers or insecticides, such as automatic sprinklers or porous pipes (see diagram n° 31)				X
Taps with hose connections			Х	
Food processes				
Dairies			х	
Food preparation			х	
Butchers and meat suppliers				Х
Abattoirs				х
Vegetable washing (see diagram n° 21)				х
Agriculture				
Boot washing systems for access to protected environments (see diagram n° 24)			х	
Milking machines, cleaning machine with addition of disinfectant (see diagram n° 20)				х
Commercial irrigation with outlets underground or at ground level and/ or permeable pipes, with or without chemical additives				x
Commercial hydroponic systems				х
Insecticide or fertiliser application systems				х


# PROTECTION MATRIX


Type of installation		edi iteç		
	2	3	4	5
Catering				
Dish-washing machines in commercial buildings (see diagram n° 18)			х	
Bottle washing equipment (see diagram n° 19)				х
Automatic dispensers without injection of ingredients or CO2	х			
Beverage distributors in which the ingredients or CO2 are injected in the inlet or distribution pipe (see diagram n° 22)			X	
Refrigeration appliances			Х	
Machines for washing beer tanks			х	
Appliances for cleaning pipes that convey beverages in restaurants			х	
Connections with mobile structures of stands and recreational areas (see diagram n° 25)			X	
Ice-making machines	x			
Large kitchen machines with automatic filling systems	х			
Dish-washing machines in hospitals				х
Breweries and distillers			Х	
Industrial and commercial applications				
Car washing and degreasing systems (see diagram n° 26)			Х	
Commercial laundries			х	
Dry-cleaning appliances			Х	
Printing and photographic appliances			Х	
Water treatment or softening systems that use products other than salt			Х	
Washing/disinfecting systems with injection of detergents			х	
Humidifying appliances			х	
Dosing devices with cat. 4 mediums for non-potable applications			х	
Treatment with inverse osmosis (see diagram n° 16)			х	
Pressure washers (see diagram n° 27)			х	
Fire fighting systems using pressurised water			х	
Sterilizers/disinfection systems for materials packaging			Х	
Sterilizers for carcinogenic material			х	


Type of installation	Medium category			
	2	3	4	5
Water with disinfection not for human use			х	
Drain cleaning systems				х
Industrial and chemical systems				х
Laboratories				х
Mobile tank and sewer emptying systems				х
Water collection systems for non-agri- cultural uses (see diagram n° 30)				х
Drinking systems for animals (see diagram n° 29)				х
Water collection systems for fire fighting applications				х
Medical				
Disinfecting systems			х	
X ray machines, cooling appliances			х	
Domestic dialysis machines		х		
Medical or dentistry appliances with under head inlet (see diagram n° 28)				х
Bed pan washing systems				х
Clothes washing systems in hospitals				х
Domestic appliances such as washtubs, sinks and hand basins				х
Hospital dialysis machines				х
Laboratories				х
Mortuary appliances				х

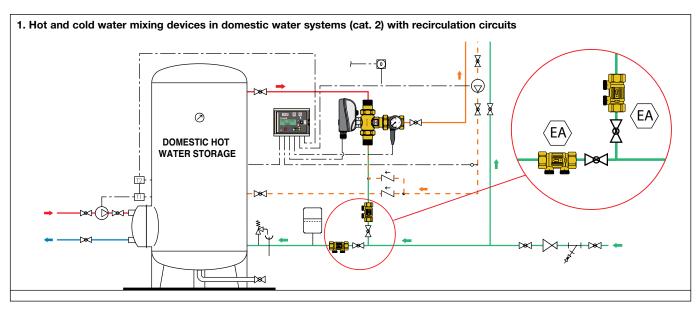


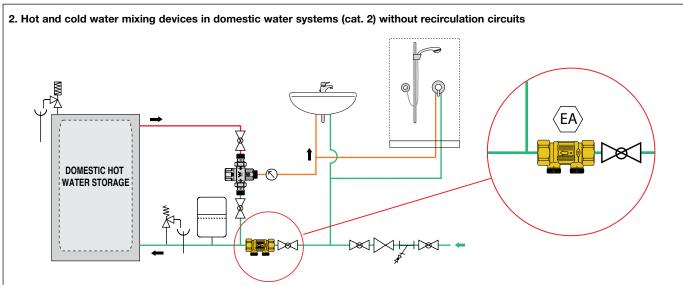


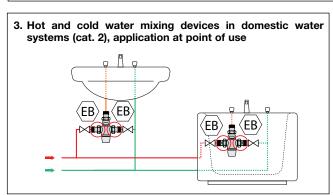


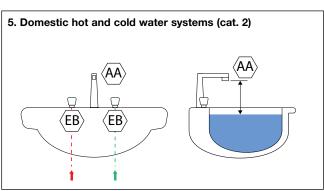


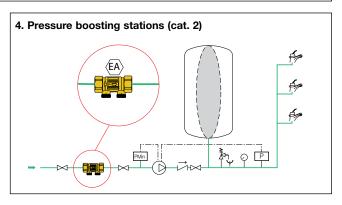


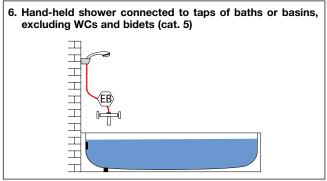


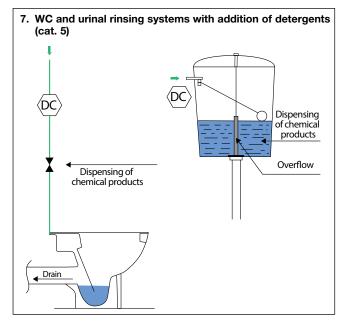


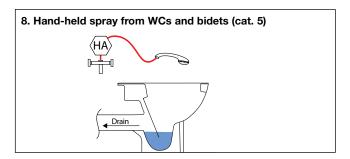


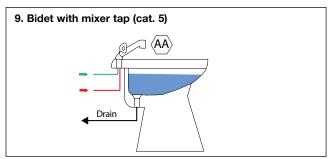


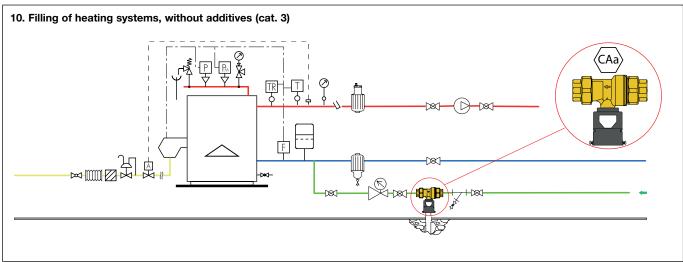


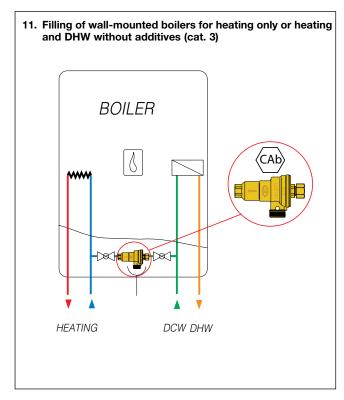


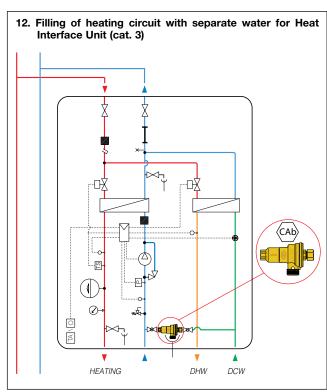


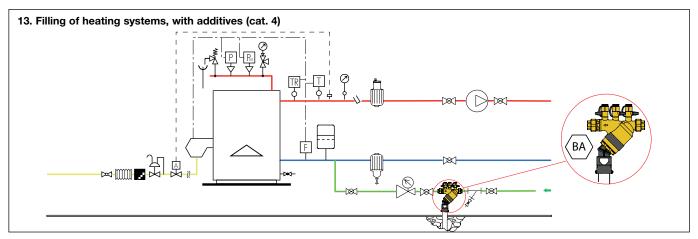


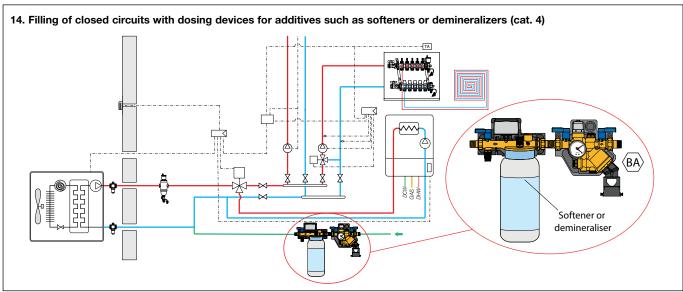


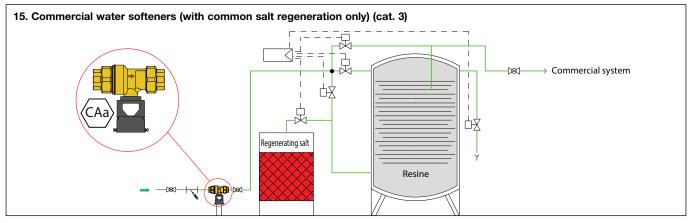


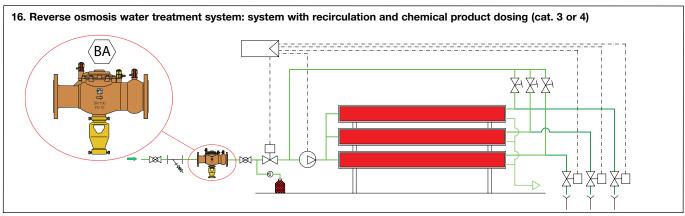


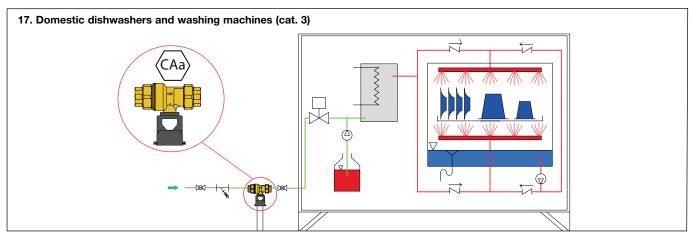


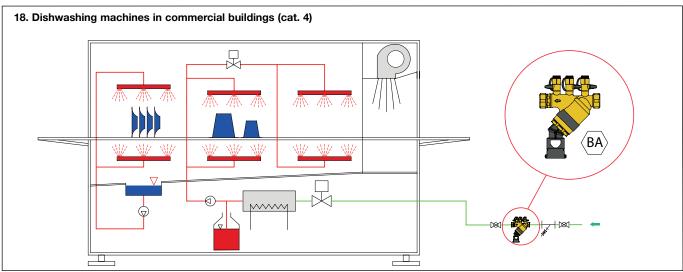


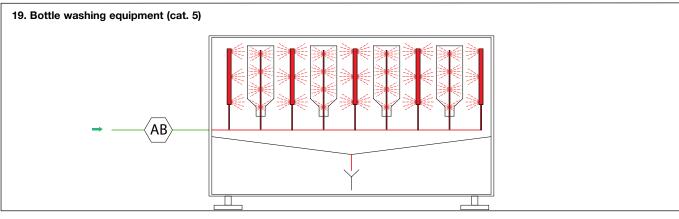


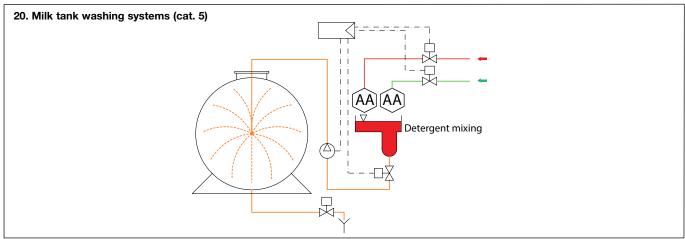


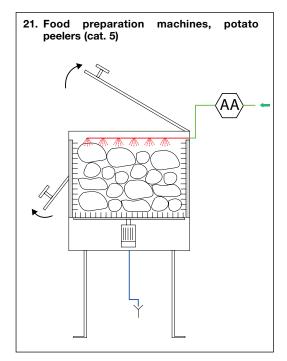


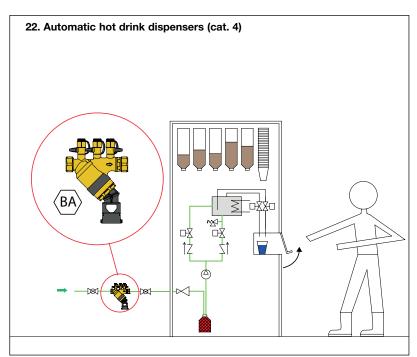


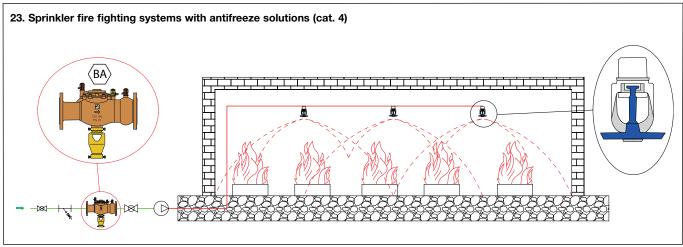


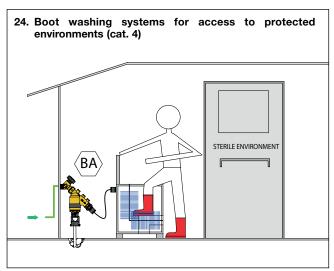


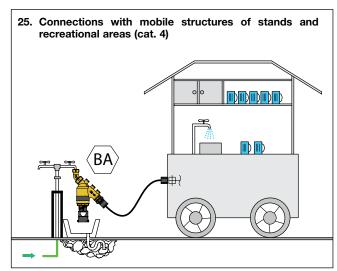


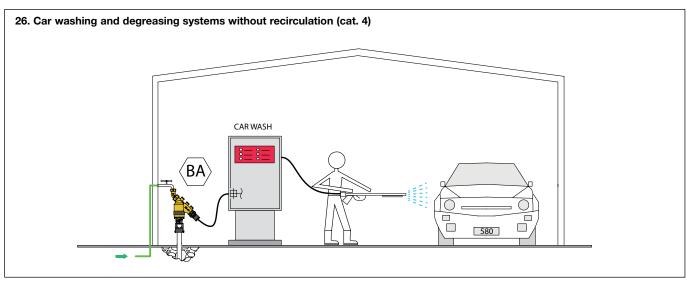


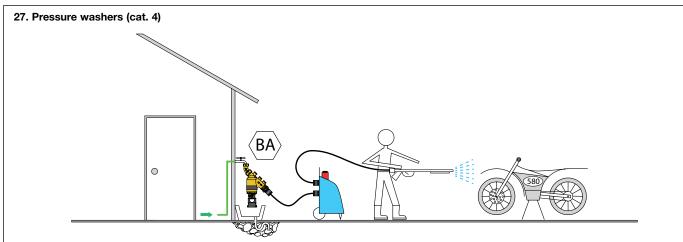

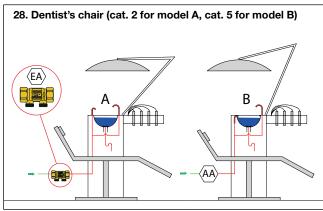

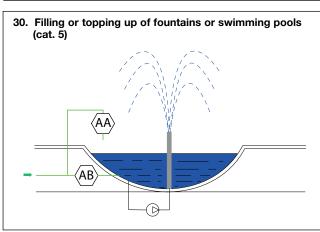

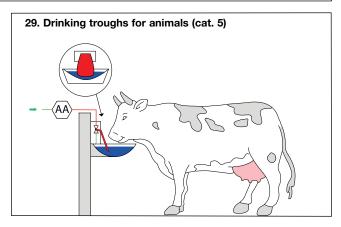

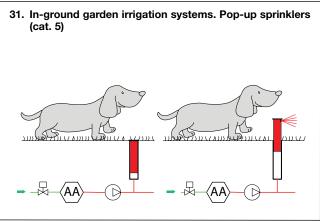

# **ANTI-POLLUTION CHECK VALVES**













tech. broch. 01005

Check valve.

EA type. Controllable. Brass body. Medium: potable water.

Maximum working pressure: 10 bar. Check valve minimum opening pressure

Maximum working temperature: 90 °C. **Certified to EN 13959.** 





3046

**G** tech. broch. 01005

Check valve.

EA type. Controllable. Brass body.

Captive nut connections - male. Maximum working pressure: 10 bar. Maximum working temperature: 90°C.

Certified to EN 13959.

Code	DN internal check valve	Connections
<b>3045</b> 40	15	1/2" F
<b>3045</b> 50	20	3/4" F
<b>3045</b> 60	25	1" F
<b>3045</b> 70	32	1 1/4" F
<b>3045</b> 80	40	1 1/2" F
<b>3045</b> 90	50	2" F













3046

**G** tech. broch. 01005

Compact check valve, EA type. EA type. Controllable. Brass body. Captive nut connections - male. Maximum working pressure: 10 bar. Maximum working temperature: 90°C. **Certified to EN 13959.** 













**G** tech. broch. 01005

Check valve. **EA type.** Controllable. Brass body. Captive nut connections - male. Maximum working pressure: 10 bar.

3046 G tech. broch. 01005

Check valve. EA type. Controllable.

Captive nut connections - male. Maximum working pressure: 10 bar. Maximum working temperature: 90°C.

Certified to EN 13959.

Maximum working temperature: 90°C. Certified to EN 13959.

Code	DN internal check valve	Connections
<b>3046</b> 40	15	3/4" F x 3/4" M
<b>3046</b> 50	20	1" F x 1" M
<b>3046</b> 60*	25	1 1/4" Fx 1 1/4" M
<b>3046</b> 70*	32	1 1/2" Fx 1 1/2" M
<b>3046</b> 80*	40	2" F x 2" M

<sup>\*</sup> Not NF and SVGW certified












Code	DN internal check valve	Connections
<b>3046</b> 44	15	3/4" F nut x 3/4" M
<b>3046</b> 54	20	1" F nut x 1" M

Brass body.







3047 G tech. broch. 01005

Check valves. EB type. Medium: potable water. Maximum working pressure: 10 bar. Check valve minimum opening pressure (Δp): 0,5 kPa. Maximum working temperature: 90°C.

Code	DN internal check valve	Connections	
<b>3047</b> 40	15	1/2" F	
<b>3047</b> 50	20	3/4" F	
<b>3047</b> 60	25	1" F	



3048

tech. broch. 01005

Double check valve. Controllable. Brass body. Female - female connections. Maximum working pressure: 10 bar. Maximum working temperature:



Code	DN internal check valve	Connections
<b>3048</b> 40	15	1/2" F
<b>3048</b> 50	20	3/4" F



3041

tech. broch. 01005

Ball valve with approved built-in check valve. Controllable. Brass body. Captive nut connections - male. Maximum working pressure: 10 bar. Maximum working temperature: 90°C.



<b>3041</b> 40	15	3/4" F nut x 3/4" M	
Code	DN internal check valve	Connections	


# **ANTI-POLLUTION CHECK VALVES**

### **Operating principle**

The anti-pollution check valve consists of a valve body (1), a check valve (2) and, if necessary, one or more pressure test ports (3) for operation checking and system testing. The check valve (2) delimits two distinct zones: one upstream or at the inlet (A), and one downstream or at the outlet (B).


#### **Correct flow conditions**

In correct flow conditions, the check valve (2) opens automatically when the pressure in the flow direction upstream (A) is greater than the downstream value (B).

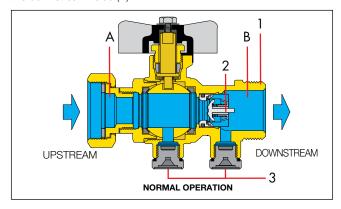


#### No flow conditions

The check valve (2) closes in advance under the action of the force exerted by the spring when the pressure downstream (B) begins to equal the value upstream (A), after the flow has stopped.

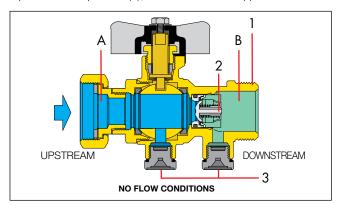

#### **Upstream pressure loss**

The check valve (2) remains closed, preventing water which has already been sent to the user from flowing back towards the public network.

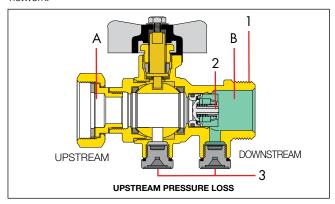

## Downstream counter pressure


If the pressure in the downstream zone (B) increases until it exceeds the upstream pressure value (A), the check valve (2) remains closed, thus preventing water that has already been sent to the user from flowing back towards the mains water system.

# Installation and maintenance procedures (operation check)

#### **EA - EC TYPE**

#### Installation

Before installation, make sure that the device is suitable for protecting the supply system, in relation to the type of medium used in the system. The controllable check valve should be installed in an accessible position upstream of a shut-off valve.



Before installing, flush the pipe with a high flow rate water jet: lack of cleaning can easily result in impaired operation of the product. Inspection and maintenance (operation check) procedures should be carried out at least once a year, in accordance with EN 806-5.

#### Inspection

Check whether the installation standards still require the application of the same device for the type of medium used in the system. Make sure that the hazard level of the medium in the system has not altered over time. Check that the surrounding environment is clean, the valve is accessible and that there are no leaks, corrosion or deterioration.

## Maintenance (operation check)

To test the seal of the check valve, check that the valve closes each time the pressure in the upstream water supply drops, thus preventing water from the system flowing back into the water supply line:

a) to maintain pressure in the installation in the absence of flow, close all shut-off valves or users downstream of the valve. Using the downstream test port (B), check that the pressure is greater than 0,5 bar.

b) close the upstream shut-off valve (1) and open the test port (A) of the check valve. The flow should stop once the upstream section of pipe has emptied;

c) if not, check the sealing-tightness of the upstream shut-off valve (1): if this valve is sealing correctly but the flow from the test port (A) continues, replace the check valve, as the flow can only be caused by imperfect sealing of the valve;

d) test port (B) (if present) can be used with a pressure gauge to test system pressure downstream of the check valve.

## **EB TYPE**

## Installation

The EB check valve installation procedure is the same as that for the EA valve.

## Inspection and maintenance (operation check)

Inspection and operation check procedures should be carried out at least once a year, in accordance with EN 806-5.

#### Inspection

The EB check valve inspection procedure is the same as that for the FA valve.

## Maintenance (operation check)

Replace the valve every 10 years.

# **CHECK VALVES WITH SHUT-OFF**









S SAME	BELGAQUA

37	24
Λnti	بالمما



Anti-pollution check valve with built-in shut-off.

### EA type.

Pressure test ports upstream and downstream.

Replaceable check valve cartridge. "LOW LEAD" dezincification resistant alloy body 🖪.

Medium: potable water.

Maximum working pressure: 10 bar. Check valve minimum opening pressure ( $\Delta$ p): 0,5 kPa.

Maximum working temperature: 65°C.

#### Certified to EN 13959 and EN 13828 standards.

PATENT PENDING.

Code	DN internal check valve	Connections	
<b>324</b> 140	20	1/2" M	
<b>324</b> 150	20	3/4" M	

inlet (A), and one downstream or at the outlet (B). **Operating conditions** Three possible operating conditions can be obtained according to the

The anti-pollution check valve with built-in shut-off valve is comprised

of a valve body (1), a check valve (2), two test ports (3) – one upstream

for operation checks and one downstream for system pressure testing

The check valve (2) delimits two distinct zones: one upstream or at the

position of the control lever: 1) lever longitudinal to the valve: normal operating conditions

- a shut-off ball valve (4) with control lever (5).

- 2) lever perpendicular to the valve, rotated clockwise through 90° relative to the longitudinal position: EA check valve operation check
- lever perpendicular to the valve, rotated anti-clockwise through 90° relative to the longitudinal position: operation access to EA check valve for maintenance or replacement.

#### Correct flow conditions

**Operating principle** 

In correct flow conditions, the check valve (2) opens automatically when the pressure in the flow direction upstream (A) is greater than the downstream value (B).









THE THE PARTY OF T	
	DN
Code	internal check valve

324



Anti-pollution check valve with built-in shut-off.

#### EA type.

Pressure test ports upstream and downstream.

Replaceable check valve cartridge. "LOW LEAD" dezincification resistant alloy body **R**.

Medium: potable water. Maximum working pressure: 10 bar Check valve minimum opening pressure (Δp): 0.5 kPa Maximum working temperature: 65°C.

## Certified to EN 13959 and EN 13828 standards.

PATENT PENDING.

Code	internal check valve	Connections	
<b>324</b> 250	20	3/4" F nut x 3/4" M	







DNI

**324** 

## **G** tech. broch. 01341

Anti-pollution check valve with built-in shut-off.

### EA type.

Pressure test ports upstream and downstream.

Replaceable check valve cartridge. "LOW LEAD" dezincification resistant alloy body CR.

Medium: potable water.


Maximum working pressure: 10 bar Check valve minimum opening pressure (Δp): 0,5 kPa.

Maximum working temperature: 65°C.

### Certified to EN 13959 and EN 13828 standards.


PATENT PENDING

Code	internal check valve	Connections	
<b>324</b> 110	20	Ø 15	
<b>324</b> 120	20	Ø 22	

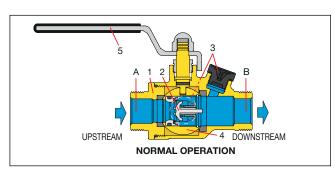


#### No flow conditions

The check valve (2) closes in advance under the action of the force exerted by the spring when the pressure downstream (B) begins to equal the value upstream (A), after the flow has stopped.

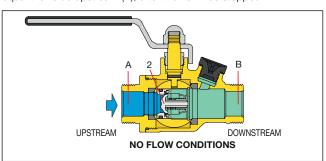

## Upstream pressure loss

The check valve (2) remains closed, preventing water which has already been sent to the user from flowing back towards the public network.

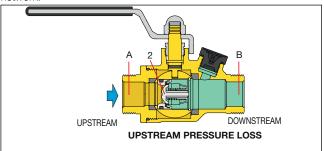

### Downstream counter pressure

If the pressure in the downstream zone (B) increases until it exceeds the upstream pressure value (A), the check valve (2) remains closed, thus preventing water that has already been sent to the user from flowing back towards the mains water system.

# **CHECK VALVES WITH SHUT-OFF**


# Installation and maintenance procedures (operation check)

For installation and inspection, refer to the indications in the previous pages for EA and EC type devices.

#### Maintenance (operation check)

To test the seal of the check valve, check that the valve closes each time the pressure in the upstream water supply drops, thus preventing water from the system flowing back into the water supply line:

a. to maintain pressure in the installation in the absence of flow,



close all shut-off valves and users downstream of the valve. Using the downstream test port, check that the pressure is greater than 0,5 bar.

**b.** close the built-in shut-off valve, rotating it clockwise through 90° relative to the longitudinal position, and open the check valve test port. The flow should stop after the small amount of medium contained in the valve body between the shut-off and pressure test port has drained off;

**c.** if not, check the seal of the built-in shut-off valve: if this valve is sealing correctly but the flow from the test port continues,


replace the check valve, as the flow can only be caused by imperfect sealing of the valve;

**d**. the pressure gauge, supplied as an optional item, can be used to test system pressure downstream of the check valve.

## Replacement of the check valve

Thanks to the special patented design, all operation check or replacement operations can be carried out using just one shut-off valve:

- position the lever perpendicular to the valve body by raising it slightly and rotating it anti-clockwise through 90° relative to the longitudinal position;
- open the side cap;
- remove the snap ring;
- use pliers to remove the check valve, taking care not to damage it. Carry out the maintenance operations, position the original or replacement check valve in its seat and refit by reversing the removal procedure.

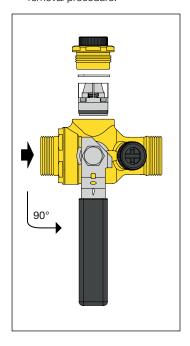





1/2" M x captive nut 3/4" F butterfly handle


3/4" M x captive nut 3/4" F butterfly handle

#### **Operating principle**

**334**400

**334**500

The valve consists of a ball (1) containing a suitably hydraulically-shaped check valve obturator (2). During normal circulation of the medium within the system, the obturator is pushed against the counter-spring (3) inside it, so as to open the channel to allow the medium to flow through. When the pressure downstream of the valve exceeds the upstream value, the obturator is pushed in the opposite direction, against the seal seat on the ball (4), in order to prevent medium back flow. Plus, when there is no flow, the valve closes thanks to the action of the counter-spring. The obturator, thanks to the thrust produced by the counter-spring (3) and the downstream pressure, completely shuts off the flow of medium through the specially shaped seal (5) (positioned on the ball seal seat or on the obturator, depending on the version). The ball, equipped with a butterfly handle (6) or lever depending on the size of the valve, acts as a normal shut-off device.

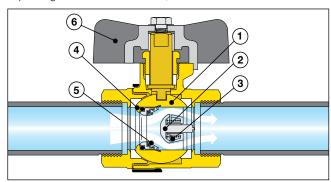

### Installation

The Caleffi 3230, 332, 333 and 334 series BALLSTOP ball valves with built-in check valve are designed for use in domestic water systems which require an interceptable check valve.

The ball shut-off valve with built-in check valve should be installed in the system in accordance with the flow direction indicated on the plastic band applied to the valve body. The valve can be fitted in any position, horizontal, vertical, or upside down.

The inspection and maintenance (operation check) of BALLSTOP valves series 3230-332-333-334 should be carried out with the same frequency and using the same procedures as indicated for EB type check valves.

# **572**



Non-controllable backflow preventer with different pressure zones, for domestic gas boilers.

**CAb type.** Brass body. PN 10. Fittings for Ø 6 copper pipe. Maximum working temperature: 40 °C. **Certified to EN standard 14367**.





Code

**572**106



**573** 



Non-controllable backflow preventer with different pressure zones. **CAa type.** Brass body. PN 10. Female connections with union. Maximum working temperature: 65°C. **Certified to EN standard 14367**.













Code	Connections	
<b>573</b> 415	1/2"	
<b>573</b> 515	3/4"	

### **Normative references**

According to product standard EN 14367, CA type backflow preventers are further subdivided into classes "a" and "b" according to the following technical requirements:

- backflow preventers in Family C, Type A, class "a", for general use, shall be capable of working at any pressure up to 1 MPa (10 bar), with any pressure variation up to 1 MPa (10 bar), at a supply temperature limit of 65 °C and 90 °C for one hour;
- backflow preventers in Family C, Type A, class "b", for specific use, shall be capable of working at any downstream pressure up to 0,3 MPa (3 bar) and with any downstream pressure variation up to 0,3 MPa (3 bar). CAb type backflow preventers, with specific hydraulic characteristics but no acoustic requirements, are intended for use as charging units in boilers for heating or heating/domestic hot water production. Such boilers can have a maximum power output of 70 kW and maximum working temperature of 110 °C.

### **Operating principle**

The CA type non-controllable backflow preventer with different pressure zones includes: an upstream check valve (1), a downstream check valve (2), a discharge device (3).


The two check valves mark off three different zones, each of which at a different pressure: an upstream or inlet zone (A); an intermediate zone, also known as the reduced pressure zone (B); a downstream or outlet zone (C).

The discharge device (3) is located in the intermediate zone. The discharge device (3) is connected directly to the diaphragm (4). This mobile assembly is opened and closed by the difference in pressure between upstream and downstream of the check valve and by the counter spring (5).

#### Correct flow conditions


Under correct conditions of flow, both check valves (1 and 2) are open, while the pressure in the intermediate chamber (B) is always lower than the pressure upstream (A) due to a pre-calculated head loss at the

first check valve (1). As a result, this pressure difference acts on the internal diaphragm (4) and generates a force that keeps the drain valve closed (3), communicating with the atmosphere, pressing on the counter-spring (5).



#### No flow conditions

The check valves (1) and (2) are now closed. Due to the difference in pressure that still exists between the upstream zone (A) and the intermediate zone (B), the drain valve (3) remains closed.




## **Upstream pressure loss**

Both check valves (1 and 2) close as the pressure upstream drops. The drain valve (3) opens at the moment in which the difference in pressure  $\Delta p$ , existing between the upstream (A) and intermediate(B) zones reaches a value just below the one pre-calculated for the counter spring (5). Drainage continues until the intermediate chamber of the backflow preventer is empty.

This creates a (safety) air zone and prevents the contaminated water in the circuit, originating from zone (C), from returning into the water distribution mains, also

in case of check valve (2) failure.

When the situation returns to normal (pressure upstream greater than pressure downstream), the drain valve closes and the backflow preventer is again ready to operate.



## Downstream counter pressure

If the pressure in the downstream zone (C) increases until it exceeds the upstream pressure value (A), the check valve (2) closes, thus preventing the water that has already been sent to the user from flowing back towards the water main.

Should check valve (2) have a slight sealing problem, or in general should any other malfunction occur in the backflow preventer, the latter will always shut off (disconnect) the connection between the user and the water main

In fact the backflow preventer was designed with all the construction solutions required for a positive action device; the best possible safety conditions are therefore ensured under all conditions.

#### **Construction details**

#### **Corrosion-proof materials**

The materials used to manufacture the backflow preventers must be immune from corrosion caused by contact with potable water, and these characteristics must be maintained over time. For this reason, they have been made using dezincification resistant alloy for the central obturator seat (6) and the check valves (1-2), and stainless steel for the springs and strainer (7).

#### Elastomers complying with food regulations

The elastomers used for the hydraulic seals have been approved by the Certifying Bodies in accordance with the most recent provisions regarding compatibility for use with potable water.


#### Stainless steel strainer

The backflow preventer is fitted with a stainless steel strainer (7) upstream, to prevent impurities or dirt from causing damage to the check valve seals (1-2) or the central obturator internal mechanism (6) over time.

# Installation and maintenance procedures (operation check)

#### Installation

The backflow preventer must be installed horizontally with a shut-off valve and an inspectable strainer upstream and another shut-off valve downstream.

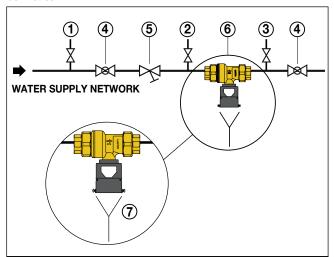

- 1 Water mains control cock
- 2 Upstream control cock
- 3 Downstream control cock
- 4 Upstream/downstream shut-off valve
- 5 Y-strainer
- 6 Backflow preventer, 573 series with inspectable strainer at the inlet
- 7 Drain to sewerage

The unit must be installed in an accessible area that is large enough to prevent it getting submerged by any accidental flooding. The drain valve must be appropriately connected to a drain.

Before installing, flush the pipe with a high flow rate water jet: lack of cleaning can easily result in impaired operation of the product.

According to standard EN 806-5, inspection procedures must be carried out once every six months. The maintenance (operation check) procedures should be carried out at least once a year.

#### Inspection

Check for possible changes in the use of the water downstream from the device and the suitability of the unit to protect the water mains. Make sure there is accessibility to the protection unit and ventilation of the place of installation; that the installation position is not subject to immersion in the case of flooding, and that there is protection against frost and excessively high temperature conditions.

Check functionality of the components of the protection unit (valves, strainer, pressure test ports), vertical positioning of the drain, the distance of the device from the drainage conveyance system, and the surface conditions (corrosion or deterioration).


Any potential backflow can be no greater than the device's discharge capacity: also check the ability of the drainage circuit to receive the discharged water and the presence of water in the syphon, if fitted.

#### Maintenance (operation check)

#### 1. Discharge checking operation (disconnection).

A pressure drop in the water mains upstream of the valve must cause the drain valve to open, with consequent emptying of the water contained in the valve body:


- Close the shut-off valves upstream and downstream (4) of the backflow preventer.
- Open control cock (2) to lower the upstream pressure. The device should intervene by opening the drain to empty the water inside the valve body.

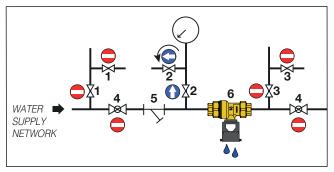

## 2. Check the tightness of the second check valve.

In case of downstream counter pressure of the backflow preventer, the second check valve must close to prevent reverse flow of the water:

- Close the shut-off valves upstream and downstream (4) of the backflow preventer.
- Open control cock (2) to lower the upstream pressure.
- Install a by-pass hose to connect control cock (1) to control cock (3) downstream: open both cocks to carry the mains pressure downstream of the second check valve. If there is no more water discharged from the drain valve, this means that the second check valve is working correctly.

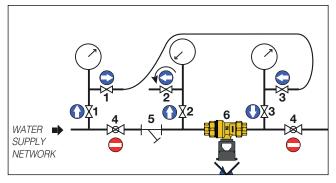

If symptoms of incorrect operation persist after having performed the checking procedure described above, the entire backflow preventer must be replaced with a new device, since it is not possible to access the internal components to replace individual parts.



## **580**

tech. broch. 01322

BA Type **backflow preventer** with multifunction geometry.

Dezincification resistant alloy body **R**. PN 10. Max. working temperature 65 °C. Maximum differential operating pressure 14 kPa. **Certified to EN standard 12729.** 



kiwa









Code	DN	Connections
<b>580</b> 004	15	1/2" M with union
<b>580</b> 040	15 (DN 20 cartridge)	1/2" M with union
<b>580</b> 050	20	3/4" M with union
<b>580</b> 060	25	1" M with union
<b>580</b> 070	32	1 1/4" M with union



# 580



BA type **backflow preventer** with multifunction geometry for special applications. Dezincification resistant alloy body **R**. PN 10.

Max. working temperature 65 °C. Maximum differential operating pressure 14 kPa. **Certified to EN standard 12729.** 









kiw

Code	DN	Connections
<b>580</b> 104	15	3/4" nut x 3/4" M
<b>580</b> 150	20	3/4" nut x 3/4" M
<b>580</b> 240	15 (DN 20 cartridge)	1/2" M x 3/4" M
<b>580</b> 250	20	3/4" M x 3/4" M


#### **Operating principle**

The controllable reduced pressure zone backflow preventer is composed of: a body (1); a self-contained cartridge (2) equipped with an upstream check valve (3); a downstream check valve (4); a discharge device integrated with the cartridge (5). The two check valves mark off three different zones, each of which at a different pressure: an upstream or inlet zone (A); an intermediate zone, also known as the reduced pressure zone (B); a downstream or outlet zone (C). Each of these is equipped with a test port connection for pressure measurement. A discharge device (5) is located in the lower part of the intermediate zone. The obturator of the discharge device is connected to the diaphragm (6). This mobile unit is pushed upwards by the spring (7). The diaphragm (6) separates the upstream zone from the intermediate zone.

## **Correct flow conditions**


Under normal flow conditions, both check valves (3 and 4) are open, while the pressure in the intermediate chamber (B) is always lower than the inlet pressure (upstream A) by at least 14 kPa due to the pressure drop caused by the check valve (3). In this situation, the mobile unit consisting

of the diaphragm (6) and the valve obturator (5) is pushed down by the thrust created by the difference in pressure acting on the diaphragm, which is greater than that of the spring (7) acting in the opposite direction. The drain valve (5) is therefore held in the closed position.




#### No flow conditions

The check valves (3) and (4) are now closed. Since the pressure in the upstream zone (A) is still at least 14 kPa higher than the pressure in the intermediate chamber (B), the drain valve (5) remains closed.

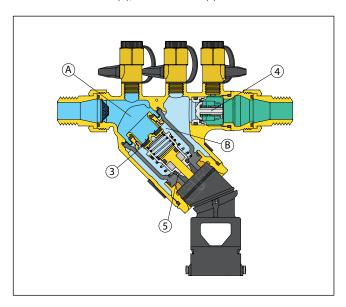

#### **Upstream pressure loss**

The check valves (3 and 4) close as the pressure upstream (A) drops. The drain valve (5) opens when the difference in pressure  $\Delta p$  between the upstream (A) and intermediate (B) zones falls, reaching a value a little bit higher than 14 kPa. Under these conditions the action exerted by the pressure difference  $\Delta p$  on the diaphragm (6) becomes weaker than that exerted by the spring (7) and the drain valve (5) opens as a result. Discharge then occurs until the body of the backflow preventer is empty. When the situation returns to normal (upstream pressure (A) greater than downstream pressure (C)), the drain valve (5) closes and the backflow preventer is again ready to operate.

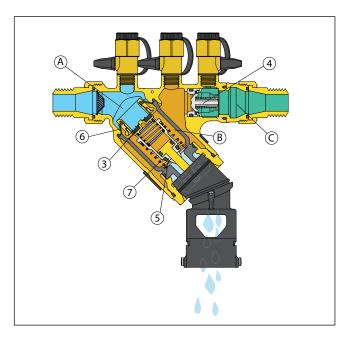

## Downstream counter pressure


If the pressure in the downstream zone (C) increases until it exceeds the upstream pressure value (A), the check valve (4) closes, thus preventing the water that has already been sent to the user from flowing back towards the water main. If the seal of the check valve (4) is slightly defective or in general terms there is any other type of fault in the backflow preventer, the device always interrupts (disconnects) the connection between the mains system and the user system. State of the backflow preventer has been designed with all construction details required for a properly functioning positive action device; the best possible safety conditions are therefore ensured under all conditions.

#### **Construction details**

#### Self-contained cartridge and diaphragm

The self-contained cartridge comprises, all in one piece, the diaphragm, the upstream check valve, the drain valve and the whole activation system. In case of maintenance, it can be easily extracted from the body without the aid of further seal elements.

The diaphragm, integrated with the cartridge, separates the upstream zone from the intermediate zone. It also acts as a hydraulic seal between the two zones. For this reason, there are no O-rings between the two zones.

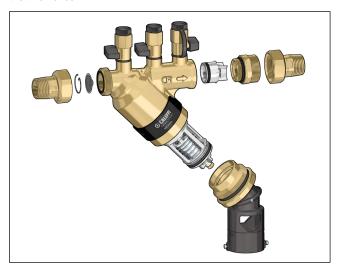


#### Discharge tundish


In compliance with standard EN 1717, backflow from the connected pipe must be prevented during water discharge from the backflow preventer, and discharge must occur without any water sprinkling to the outside. Consequently the tundish connected to the discharge pipe must be of an appropriate size with special openings to create the necessary air gap and it must be equipped with a suitable flow conveyor. Thanks also to the possibility of orienting the tundish, the same body can be used in three different configurations: installation on horizontal or vertical pipes or for special applications.



#### **Built-in upstream strainer**


The upstream strainer, required by the protection unit according to standard EN 1717, is located in the upstream connection of the valve body and is easily accessible for maintenance.





#### Downstream check valve

The downstream check valve is positioned before the outlet connection and is held in place by a special locking nut. For maintenance, just remove the downstream union and the locking nut.



### Hose connection

The version for special applications is provided as standard with a 3/4" hose connection x 1/2" pipe on the outlet connection.



#### Versatility

The version for in-line installation (on a horizontal or vertical pipe) can be easily converted into a version for special applications, and vice versa, thanks to the interchangeability of the upstream union with the elbow union and the shut-off valve upstream.

Thanks to the compactness and versatility of the body, the 580 series backflow preventer is suitable for protecting systems with mediums of even lower than category 4, so that only one device need be kept in stock.

#### **Corrosion-proof materials**


The materials used to manufacture the backflow preventers must be insensitive to corrosion caused by contact with potable water. They are therefore constructed using a dezincification resistant alloy, plastic materials and stainless steel to ensure high performance over time.

# Installation and maintenance procedures (operation check)

The backflow preventer must be installed in an accessible zone, where there is no risk of accidental flooding or frost. If there is a risk of frost, especially for the backflow preventer version for special applications, it is recommended to remove the device during the coldest hours. The discharge tundish must be turned downwards and connected to the pipe leading to the sewer.

For the protection of the public mains the backflow preventer must be installed after the water meter, whereas in order to protect the tap water outlets of the domestic internal network it should be installed at the limit of the areas where there may be contamination due to backflow.


The in-line backflow preventer, codes 580040/050, must be installed with one shut-off valve upstream and one downstream (not supplied in the package). According to the indications of regulation EN 1717, the backflow preventer is equipped with an inspectable strainer, located in the upstream connection of the body and easily accessible for maintenance, and an adjustable discharge tundish. The appliance should be installed horizontally, in accordance with the flow direction indicated by the arrow on the valve body. Installation on a vertical pipe with downward flow (from top to bottom) is also allowed, respecting the direction of flow indicated by the arrow on the valve body. In the case of particularly dirty mediums, consider installing an additional inspectable strainer upstream.

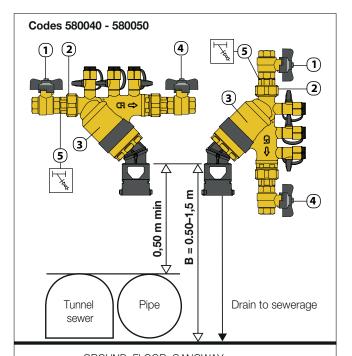

# GROUND, FLOOR, GANGWAY

- 1 Shut-off valve (not included in the package)
- 2 Built-in strainer
- 3 Backflow preventer
- 4 Shut-off valve (not included in the package)
- 5 Optional additional Y-strainer

The backflow preventer for special applications code 580150, equipped with a captive nut, must be fitted to the cock which thus performs the function of an upstream shut-off valve. The backflow preventer for special applications 580240/250 must be fitted directly to the pipe, as it is already equipped with an upstream shut-off valve. The connection between valve, fitting and backflow preventer can be blocked with the seal supplied in the package. According to the indications of regulation EN 1717, the backflow preventer is equipped with an inspectable strainer, located in the upstream connection of the body and easily accessible for maintenance, and an adjustable discharge tundish. The appliance must be installed with a downward flow (from top to bottom), respecting the direction of flow indicated by the arrow on the valve body. In the case of particularly dirty mediums, consider installing an additional inspectable strainer upstream.

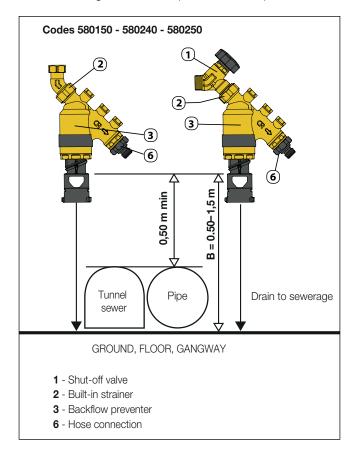

#### Inspection and maintenance (operation check)

For BA type backflow preventers, inspection procedures must be carried out every six months. while maintenance procedures (operation check) must be carried out at least once a year, in accordance with EN 806-5.

#### Inspection

Check for possible changes in the use of the water downstream from the device and the suitability of the unit to protect the water mains. Check accessibility to the protection unit, ventilation of the place of installation, that the installation position is not subject to immersion in the case of flooding, protection against frost and excessively high temperature conditions. Check functionality of the components of the protection unit (valves, strainer, pressure test ports), vertical positioning of the drain, the distance of the device from the drainage conveyance system, and the surface conditions (corrosion or deterioration). Any potential backflow can be no greater than the device's discharge capacity: also check the ability of the drainage circuit to receive the discharged water and the presence of water in the syphon, if fitted.


#### Maintenance (operation check)

The procedure involves: removal and cleaning of the upstream strainer; seal test for valves and gaskets; operation check of the backflow preventer (check valves seal and disconnection in accordance with manufacturer's instructions); cleaning of the discharge tundish; pressure testing using suitable instruments (static, dynamic, differential); logging of results of operations performed.


Functional testing of the backflow preventer can be carried out by means of a differential pressure gauge, with two Tee fittings each of which with a pressure release cock.

#### 1. Checking the upstream check valve

Code 580040/050, series 574-575-570: check for the presence of the shut-off valves upstream and downstream of the backflow preventer. Close the upstream and downstream shut-off valves.

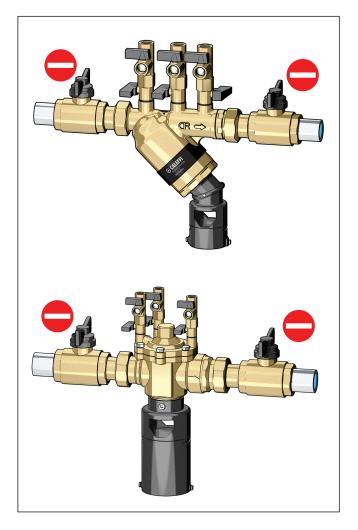


Code 580150/240/250: close the upstream shut-off valve; fit a shut-off valve in place of the hose connector outlet on the backflow preventer and close the valve; apply the upstream, intermediate and downstream pressure test ports by removing the threaded caps.

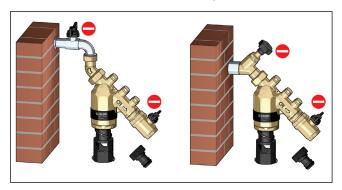



For all codes: connect the differential pressure gauge to the upstream and intermediate pressure ports. Open the test two pressure test ports connected to the differential pressure gauge while keeping the downstream pressure test port closed. Open the upstream and downstream shut-off valves. Open a downstream tap to cause a high flow rate to pass through the valve. Close the upstream and

downstream shut-off valves to achieve static conditions. If the  $\Delta p$  value decreases, this means the check valve is not water-tight and it must be checked by removing it from the valve body. The  $\Delta p$  value may fall to a safety value (above 14 kPa) at which disconnection occurs. If the pressure differential value  $\Delta p$  remains constant and above 14 kPa, the check valve is functioning correctly and you may continue with next stage.

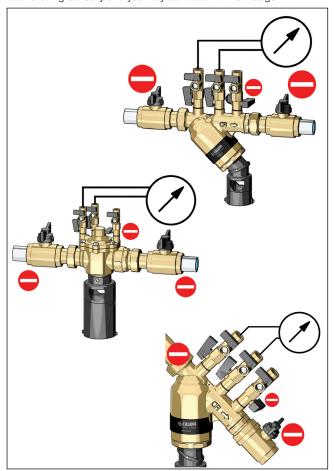


#### 2. Disconnection test

Keep the differential pressure gauge connected to the upstream and intermediate pressure test ports. Open the two test ports connected to the differential pressure gauge while keeping the downstream pressure test port closed. Open the upstream pressure release cock to reduce the upstream pressure. Disconnection must occur at a  $\Delta p$  value greater than 14 kPa. Log the  $\Delta p$  value at which the device disconnects in the commissioning report.

### 3. Checking the downstream check valve

Close the upstream and downstream shut-off valves. Close the pressure test ports. Connect the differential pressure gauge to the intermediate and downstream pressure test ports while keeping the upstream pressure test port closed. Open the upstream and downstream shut-off valves. Once again, subject the valve to a high flow rate and then close the upstream and downstream shut-off valves. Check that the  $\Delta p$  value between the intermediate chamber and the downstream chamber, as shown on the pressure gauge, is above 0,5 kPa and that this value remains constant when the downstream pressure is gradually reduced by opening the pressure release cock on the downstream pressure test port. If the  $\Delta p$  value does not remain constant, this means the check valve is not water-tight and it must be checked by removing it from the valve body.

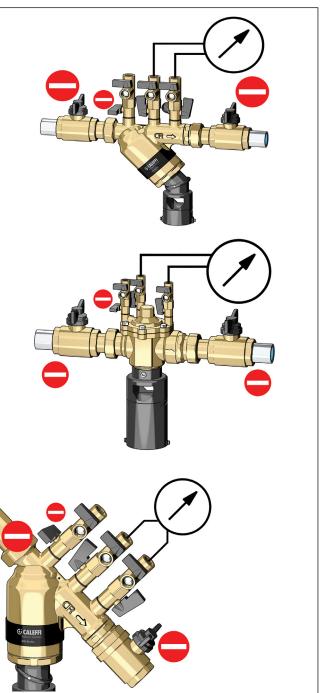





**574** 

tech. broch. 01022

Controllable reduced pressure zone backflow preventer. BA Type.

"LOW LEAD" dezincification resistant alloy body **CR**.

PN 10. Male pipe union connections. Maximum working temperature: 65 °C. Operating pressure differential: 14 kPa.

Certified to EN standard 12729.

It is essential to install the 577 series strainer upstream.

















Code F74004	Connections	
<b>574</b> 004	1/2"	











G tech. broch. 01022

Controllable reduced pressure zone backflow preventer. **BA Type.** 

"LOW LEAD" dezincification resistant alloy

PN 10. Male pipe union connections. Maximum working temperature: 65 °C. Operating pressure differential: 14 kPa.

#### Certified to EN standard 12729.

It is essential to install the 577 series strainer

















		1.07/19919	APPROVED PRODUCT
Code	Connections		CERTIFICATION MARK
<b>574</b> 040	1/2"		
<b>574</b> 050	3/4"		
<b>574</b> 006	1"		
<b>574</b> 600	1"		
<b>574</b> 700	1 1/4"		
<b>574</b> 008	1 1/2"		



# 574/575



Controllable reduced pressure zone backflow preventer. BA Type.

Bronze body. PN 10.

Male pipe union connections and flanged PN 16 connections.

Coupling with counterflange EN 1092-1. Maximum working temperature: 65 °C. Differential operating pressure 14 kPa.

## Certified to EN standard 12729.

It is essential to install the 577 (574) or 579 (575) series strainer upstream.













	1.57/19919	APPROVED PRODUCT
Code	Connections	CERTIFICATION MARK
<b>574</b> 800	1 1/2" with union	
<b>574</b> 900	2" with union	
<b>575</b> 005	DN 50 flanged PN 16	
<b>575</b> 006	DN 65 flanged PN 16	
<b>575</b> 008	DN 80 flanged PN 16	
<b>575</b> 010	DN 100 flanged PN 16	



**575** 



tech. broch. 01245

Controllable reduced pressure zone backflow preventer. BA Type. Epoxy resin coated cast iron body. PN 10.

Flanged PN 16 connections. Coupling with counterflange EN 1092-1. Maximum working temperature: 60°C. Operating pressure differential: 14 kPa. Certified to EN standard 12729.

It is essential to install the 579 series strainer upstream.





Code	Connections	
<b>575</b> 150	DN 150	
<b>575</b> 200	DN 200	
<b>575</b> 250	DN 250	



**570** 



Assembly consisting of: 574 series backflow preventer; 577 series Y-strainer; manual shut-off valves. PN 10.

Female-female connections. Maximum working temperature: 65 °C.

Code	Connections	
<b>570</b> 004	1/2"	_
<b>570</b> 005	3/4"	
<b>570</b> 006	1"	
<b>570</b> 007	1 1/4"	
<b>570</b> 008	1 1/2"	_
<b>570</b> 009	2"	

# **570**

Assembly consisting of: 575 series backflow preventer; 579 series Y-strainer; manual shut-off valves. PN 10. Flanged PN 16 connections.

Coupling with counterflange EN 1092-1.

Maximum working temperature: 65°C (DN 50-DN 100). Maximum working temperature: 60°C (DN 150-DN 250).




Code	Connections	
<b>570</b> 050	DN 50	Backflow preventer body in bronze
<b>570</b> 060	DN 65	Backflow preventer body in bronze
<b>570</b> 080	DN 80	Backflow preventer body in bronze
<b>570</b> 100	DN 100	Backflow preventer body in bronze
<b>570</b> 150	DN 150	Backflow preventer body in cast iron
<b>570</b> 200	DN 200	Backflow preventer body in cast iron
<b>570</b> 250	DN 250	Backflow preventer body in cast iron

#### **Operating principle**

The controllable reduced pressure zone backflow preventer is composed of: a body with an inspection cover, an upstream check valve (1), a downstream check valve (2), a discharge device (3). The two check valves mark off three different zones, each of which at a different pressure: an upstream or inlet zone (A); an intermediate zone, also known as the reduced pressure zone (B); a downstream or outlet zone (C). Each of these is equipped with a test port connection for pressure measurement. A discharge device (3) is located in the lower part of the intermediate zone. The obturator of the discharge device is connected via the valve stem (4) to the diaphragm (5). This mobile unit is pushed upwards by the counter-spring (6). The diaphragm (5) marks the limit of the operation chamber (D), which is connected to the upstream zone by the channel (7).


### Correct flow conditions

Under normal flow conditions, both check valves are open, while the pressure in the intermediate chamber (B) is always lower than the inlet pressure by at least 14 kPa to the pressure drop caused by the check valve (1). In the operation chamber (D), however, the pressure is the same as in the inlet zone. In this situation, the mobile unit consisting of the diaphragm (5), the valve stem (4) and the valve obturator (3) is pushed down by the thrust created by the difference in pressure acting on the diaphragm which is greater than that of the spring (6) acting in the opposite direction. The drain valve is therefore held in the closed position.

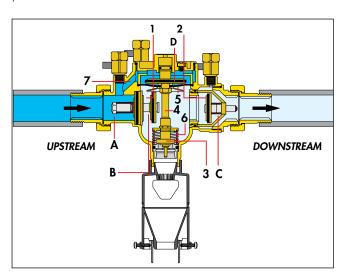

#### No flow conditions


The check valves (1) and (2) are now closed. Since the pressure in the upstream zone, and therefore also in the operation chamber (D), is still at least 14 kPa higher than the pressure in the intermediate chamber (B), the drain valve remains closed.

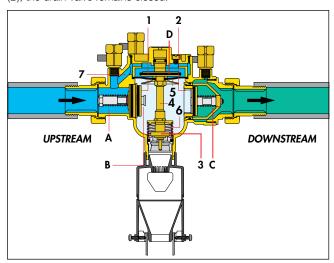

#### Upstream pressure loss

Both check valves close as the pressure upstream drops. The drain valve (3) opens at the moment in which the difference in pressure  $\Delta p$ , existing between the upstream and intermediate zones, decreases to reach a value just over 14 kPa.

Under these conditions the action exerted by the pressure difference  $\Delta p$  on the diaphragm (5) becomes weaker than that exerted by the counter-spring (6) and the drain valve (3) opens as a result. Discharge then occurs until the body of the backflow preventer is empty. When the situation returns to normal (pressure upstream greater than pressure downstream), the drain valve closes and the backflow preventer is again ready to operate.

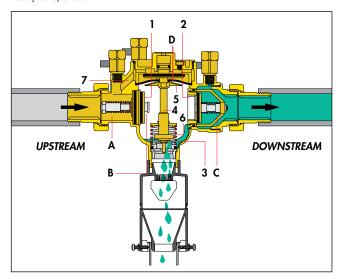

#### Downstream counter pressure

If the pressure in the downstream zone increases until it is greater than the upstream pressure, the check valve (2) closes and therefore prevents water already delivered to the user from returning back into the mains system. If the seal of the check valve (2) is slightly defective or in general terms there is any other type of fault in the backflow preventer, the device always interrupts (disconnects) the connection between the mains system and the user system. The backflow preventer has been designed with all construction details required for a properly functioning positive action device; the best possible safety conditions are therefore ensured under all conditions.

# Installation and maintenance procedures (operation check)


### Installation

The backflow preventer must be installed on a horizontal pipe with a shut-off valve and an inspectable strainer upstream and a further shut-off valve downstream. The backflow preventer must be installed in an accessible zone, where there is no risk of accidental flooding or frost. The discharge tundish must be oriented downwards and connected to the sewer.

Before installing the backflow preventer and strainer, flush the pipe with a high flow rate.

## Inspection and maintenance (operation check)

For BA type backflow preventers, inspection procedures must be carried out every six months. while maintenance procedures (operation check) must be carried out at least once a year, in accordance with EN 806-5. For a description of the procedures, see page 22.

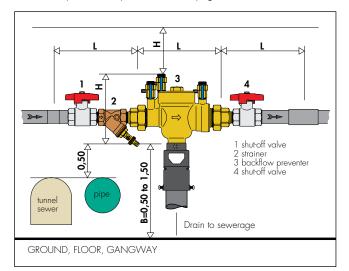

# **CHARGING UNITS**

**580**01.

tech. broch. 01333

Automatic compact filling unit to EN 1717 with BA type backflow preventer, shut-off valves, strainer, pressure test ports for checking the backflow preventer, pressure reducing valve. Dezincification resistant alloy body **(Code 580010)**. Chrome plated brass body (code 580011).

With insulation.

Adjustment range of the filling unit: 0,8-4 bar.

Maximum working pressure: 10 bar. Maximum working temperature: 65°C

Backflow preventer conforming to EN 12729.

Pressure reducer to EN 1567.

PATENT PENDING.




Code	Connections	Charging flow rate @ $\Delta p = 1,5$ bar $(m^3/h)$	
<b>580</b> 010	1/2"	1.5	
<b>580</b> 011	1/2"	1.1	

## **Function**

The compact automatic charging unit is composed of a shut-off valve with an inspectable strainer, a BA type controllable reduced pressure zone backflow preventer and an automatic filling unit. It is installed on the water inlet piping in closed circuit heating systems. It maintains the pressure of the system stable at a set value, automatically topping up with water as required. The backflow preventer prevents the contaminated water of the closed heating circuit from flowing back into the domestic water supply network, in compliance with the provisions of EN 1717.


## **Characteristic components**

- Compact, self-contained body
- Two shut-off valves
- 3. Three pressure test ports
- BA type backflow preventer cartridge (EN 12729)
- 5. Charging unit cartridge (pressure reducer) (EN 1567 - W570-3)
- Inspectable/removable upstream strainer
- Inspectable/removable downstream check valve (EN 13959)
- 8. Discharge tundish (EN 1717)
- 10. Pressure gauge connection on two sides

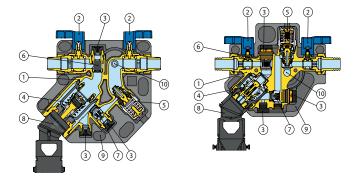

#### **Protection unit**

The compact filling unit comprises all the devices required by EN 1717 to form the protection unit for the BA backflow preventer (shut-off valves, inspectable strainer), in addition to the pressure reducing valve (charging unit).



#### **Construction details**

### Self-contained cartridge and diaphragm of the backflow preventer

The self-contained cartridge comprises, all in one piece, the diaphragm, the upstream check valve, the drain valve and the whole activation system. In case of maintenance, it can be easily extracted from the body without the aid of further seal elements. The diaphragm, integrated with the cartridge, separates the upstream zone from the intermediate zone. It also acts as a hydraulic seal between the two zones. For this reason, there are no O-rings between the two zones.



## Automatic filling unit

The system filling pressure may be set by turning the regulating screw during the system filling phase. The effective pressure is read on the pressure gauge.


The cartridge containing the diaphragm, strainer, seat, obturator and compensation piston is a pre-assembled self-contained unit with a cover and can be removed to facilitate inspection and maintenance procedures.



#### Shut-off valves, pressure test ports and upstream inspectable strainer


The shut-off valves and the three pressure test ports (to EN 12729) allow periodic operation checks of the backflow preventer and the pressure reducing valve in accordance with EN 806-5.

The upstream inspectable strainer, accordance with EN 1717, protects the backflow preventer from any impurities in the mains water supply that could impair its




## Downstream check valve


The downstream check valve is positioned before the filling unit and is held in place by a locking nut. For maintenance, simply remove the cap and the locking nut.



## Compact design and versatility

The adjustable discharge tundish means that the charging unit can be installed on horizontal and vertical pipes, with upward flow.





# **CHARGING UNITS**

### **Operating principle**

The filling unit assembly is comprised of a shut-off valve, an inspectable strainer, a backflow preventer and a filling unit. It is installed on the water inlet pipe in closed circuit heating systems, and its main function is to keep the system pressure stable at a set value by automatically topping up with water as required. The purpose of the backflow preventer is to prevent the contaminated water of the closed heating circuit from flowing back into the domestic water supply network, in compliance with provisions of EN 1717.

**573**001

**G** tech. broch. 01061

Automatic charging unit with **CAa type** backflow preventer and shut-off valves

Adjustment range of the filling unit: 0,2–4 bar. Maximum working pressure: 10 bar. Maximum working temperature: 65 °C.

Backflow preventer certified to EN standard 14367.



Code	Connections	
<b>573</b> 001	1/2"	

**574**000

**G** tech. broch. 01061

Automatic charging unit with **BA type** backflow preventer, Y-strainer and shut-off valve.

Adjustment range of the filling unit: 0,2–4 bar.

Maximum working pressure: 10 bar.

Maximum working temperature: 65 °C.

Backflow preventer certified to EN 12729.



 Code
 Connections

 574000
 1/2"

**574**001

**6** tech. broch. 01125

Charging unit with **BA type** backflow preventer, Y-strainer and shut-off valve.


Reducer adjustment range: 1–6 bar. Maximum working pressure: 10 bar. Maximum working temperature: 60 °C. Backflow preventer certified to EN 12729.



 Code
 Connections

 **574**001
 3/4"



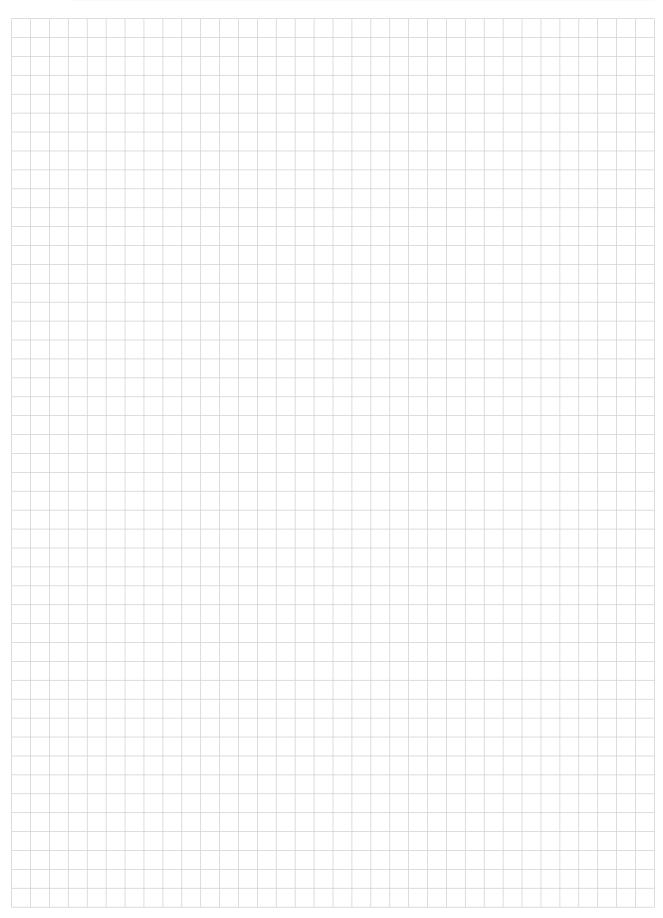





We reserve the right to make changes and improvements to our products and the related technical data in this publication, at any time and without prior notice.

The website www.caleffi.com always has the most up-to-date version of the document,

which should be used for technical verifications.



CALEFFI S.p.A. · S.R.229, N.25 · 28010 Fontaneto d'Agogna (NO) · Italy
Tel. +39 0322 8491 · info@caleffi.com www.caleffi.com

© 2022 Copyright Caleffi







