

AutoFill™ pre-adjustable automatic combination fill valve and testable RPZ backflow preventer



574 series, 1/2 inch

Submittal Data 03502 NA — Issue Date 08/2021

Application

Pre-assembled with the 574 series RPZ backflow preventer and 553 series fill valve, the AutoFill™ Combo can be used in all systems where there is danger of the potable water supply system being contaminated. It prevents an accidental reduction in the pressure in the distribution system from causing backflow from contaminated water in user installations.

The backflow preventer is ICC-ES certified to ASSE 1013, CSA B64.4 and NSF 372 low lead laws. It meets codes IPC, IRC, UPC and NPC for use in accordance with the US and Canadian plumbing codes.

Typical Specification

Furnish and install on the plans and described herein, a code 574 series, pre-adjustable automatic combination fill valve and testable, reduced pressure zone backflow preventer as manufactured by Caleffi in size 1/2" with NPT female and press connections. Each valve must be designed with a compensated seat and self-contained cartridge. The filling valve design must have a brass body and include a glass fiber reinforced nylon PA66G30 cover, filter and NBR diaphragm and seals. The filling valve must be come complete with adjustment knob with downstream pressure regulating indicator showing increasing or decreasing pressure direction for manual setting, pressure gauge with scale 0-60 psi (0-4 bar), connection 1/4" NPT male. The backflow preventer shall be designed with DZR low lead brass body and cover, stainless steel springs and peroxide-cured EPDM diaphragms and seals. The backflow preventer is provided with bronze inlet and outlet t-handle operated ball valves with 304 stainless steel ball. Each backflow preventer assembly shall be ICC-ES certified to ASSE 1013, CSA B64.4 and NSF/ANSI 372 low lead laws. It meets codes IPC, IRC, UPC and NPC for use in accordance with the US and Canadian plumbing codes. It must be designed for 150 psi (10 bar) maximum working pressure and 150°F (65°C) maximum working temperature. (See product instructions for specific installation information.)



Technical Data

Filling valve

Body: brass
 Cover: glass fiber reinforced nylon PA66G30
 Diaphragm and seals: NBR


Backflow preventer

Body: DZR low lead brass, EN 1982 CB752S
 Cover: DZR low lead brass, EN 12165 CW724R
 Check valves: PSU-POM-CW724R
 Springs: stainless steel
 Diaphragms and seals: peroxide-cured EPDM
 Discharge air-gap: PVC

Isolation ball valves, inlet and outlet

Body material: C89833 low-lead bronze
 Ball: 304 stainless steel
 Handle and nut: steel
 Seat ring and packing gland: PTFE
 Gland nut: brass
 Stem: low lead brass

Dimensions

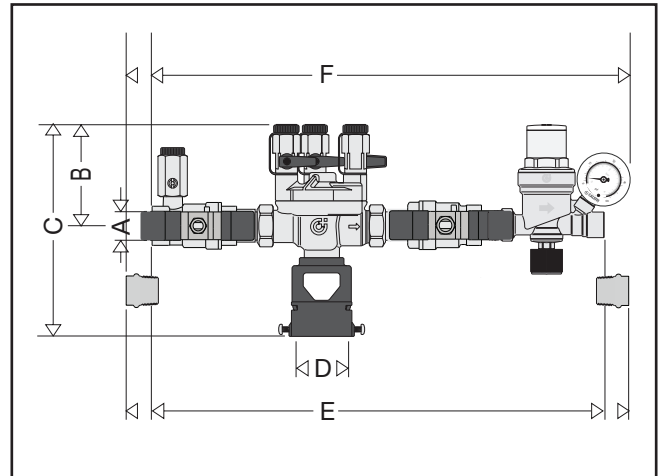

Code	A	B	C	D	E	F	Wt (lb)
574002A	1/2" FNPT	3/4"	6 1/4"	40 mm	15"	--	9.4
574112A	1/2" FNPT, gauge	3/4"	6 1/4"	40 mm	15"	16"	9.4
574206A	1/2" press	3/4"	6 1/4"	40 mm	17 ⁵ / ₈ "	--	9.4
574216A	1/2" press, gauge	3/4"	6 1/4"	40 mm	17 ⁵ / ₈ "	18 ⁵ / ₈ "	9.5
574207A	1/2" press in x FNPT out	3/4"	6 1/4"	40 mm	16 ⁵ / ₁₆ "	--	9.5
574217A	1/2" press in x FNPT out	3/4"	6 1/4"	40 mm	16 ⁵ / ₁₆ "	17 ⁵ / ₁₆ "	9.5

Lay length: 574206A & 216A...16-1/8"; 574207A & 217A...15-9/16".

Certifications-Backflow preventer

- ASSE 1013/CSA B64.4, certified by ICC-ES, file PMG-1433.
- Complies with NSF/ANSI 372, Drinking Water System Components-Lead Content Reduction of Lead in Drinking Water Act, California Health and Safety Code 116875 S.3874, as certified by ICC-ES, file PMG-1360.

Performance of combined unit

Suitable fluids: water
 Max. working pressure: 150 psi (10 bar)
 Max. working temperature: 150°F (65°C)
 Pressure test ports: upstream, intermediate, downstream
 Downstream pressure setting range: 3 - 60 psi (0.2 - 4 bar)
 Factory setting: 15 psi (1.035 bar)
 Max. flow rate: 12 gpm at 20 psid pressure drop

Pressure gauge scale: 0-60 psi (0-4 bar)
 Connections: see table above

We reserve the right to change our products and their relevant technical data, contained in this publication, at any time and without prior notice. Contractors should request production drawings if prefabricating the system

Job name _____
 Job location _____
 Engineer _____
 Mechanical contractor _____
 Contractor's P.O. No. _____
 Representative _____

Size _____
 Quantity _____
 Approval _____
 Service _____
 Tag No. _____
 Notes _____