

PresCal™ HP Low Range Heavy Duty Piston-type PRV

© Copyright 2023 Caleffi

536 Series



Function

The 536 Series low range pressure reducing valve is a heavy duty, piston-type valve with an adjustable pressure range from 10 to 90 psi. It is ideal for use in commercial laundry and kitchens, irrigation and other demanding applications where water hammer and rapid pressure fluctuations are present. All metal construction means it can be installed outdoors where freezing is not a concern.

NSF/ANSI/CAN 372
NSF/ANSI/CAN 61



Product range

536 Series pressure reducing valve with pressure gauge..... sizes ½", ¾", 1", 1-¼", 1-½" connections dual union; NPT female, press, sweat

Technical specifications

Materials

Body:	DZR low-lead cast brass CR EN 1982 CC768S
Cover:	brass EN 12165 CW617N
Control spindle:	stainless steel EN 10088-3 (AISI 303)
Spring:	stainless steel ISO 6931-1 (4310-301-00)
Moving parts:	stainless steel EN 10088-3 (AISI 303)
Seals:	peroxide-cured EPDM
Strainer:	stainless steel EN 10088-2 (AISI 304)
Seat:	stainless steel EN 10088-3 (AISI 303)
Valve plug:	DZR low-lead brass CR EN 12165 CW724R

Performance

Max. working pressure upstream:	
NPT female, sweat & ½" - 1" press:	300 psi (2000 kPa)
1¼" & 1½" press:	200 psi (1400 kPa)
Downstream pressure setting range:	10 - 90 psi (70 - 600 kPa)
Factory setting:	45 psi (300 kPa)
Max. working temperature:	180°F (80°C)
Pressure gauge scale:	0 - 100 psi (0 - 700 kPa)
Filter mesh size (diameter):	size ½" - 1": 0.2 (0.51 mm)
	size 1¼" - 1½": 0.3 (0.65 mm)

Medium:

Potable water

Flow rate:

see graph



SAFETY INSTRUCTION

This safety alert symbol will be used in this manual to draw attention to safety related instructions. When used, the safety alert symbol means **ATTENTION! BECOME ALERT! YOUR SAFETY IS INVOLVED! FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN A SAFETY HAZARD.**



WARNING: This product can expose you to chemicals including lead, which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to www.P65Warning.ca.gov.



CAUTION: Caleffi shall not be liable for damages resulting from stress corrosion, misapplication or misuse of its products.



CAUTION: All work must be performed by qualified personnel trained in the proper application, installation, and maintenance of systems in accordance with all applicable codes and ordinances.



CAUTION: If the pressure reducing valve is not installed, commissioned and maintained properly, according to the instructions contained in this manual, it may not operate correctly and may endanger the user.



CAUTION: Make sure that all the connecting pipework is water tight.



CAUTION: Over-tightening and breakage can occur with the use of Teflon[®] pipe joint compounds. Teflon[®] provides lubricity so that care must be exercised not to over-tighten joints . Failure to follow these instructions could result in property damage and /or personal injury.



CAUTION: System fluids are under pressure or temperature can be hazardous. Be sure the pressure has been reduced to zero and the system temperature is below 100°F (38°C). Failure to follow these instructions could result in property damage and/or personal injury.

Caleffi shall not be liable for damages resulting from stress corrosion, misapplication or misuse of its products..



CONSIGNE DE SÉCURITÉ

Ce symbole d'avertissement servira dans ce manuel à attirer l'attention sur la sécurité concernant instructions. Lorsqu'il est utilisé, ce symbole signifie. **ATTENTION! DEVENEZ ALERTE ! VOTRE SÉCURITÉ EST EN JEU ! NE PAS SUIVRE CES INSTRUCTIONS PEUT PROVOQUER UN RISQUE DE SECURITE.**



AVERTISSEMENT: Ce produit peut vous exposer à des produits chimiques comme le plomb, qui est connu dans l'État de Californie pour causer le cancer, dommages à la naissance ou autre. Pour plus d'informations rendez-vous www.P65Warnings.ca.gov.



AVERTISSEMENT: Caleffi ne sera pas responsable des dommages résultant de la corrosion sous tension, d'une mauvaise application ou d'une mauvaise utilisation de ses produits.



AVERTISSEMENT: Tous les travaux doivent être effectués par du personnel qualifié formé à la bonne application, installation et maintenance des systèmes conformément aux codes et règlements locaux.



AVERTISSEMENT: Si le réducteur de pression n'est pas installée, mis en service et entretenu correctement, selon les instructions contenues dans ce manuel, il peut ne pas fonctionner correctement et peut mettre en danger l'utilisateur.



AVERTISSEMENT: S'assurer que tous les raccords sont étanches.




AVERTISSEMENT: Un serrage excessif et une rupture peuvent survenir avec l'utilisation de Teflon® composés de joint de tuyau. Le Teflon® offre un pouvoir lubrifiant de sorte que les soins doivent être exercé pour ne pas trop serrer les joints. Non-respect de ces instructions pourrait entraîner des dommages matériels et / ou des blessures corporelles.



AVERTISSEMENT: Les fluides du système sont sous pression ou la température peut être hasardeux . Assurez vous que la pression a été réduite à zéro et que le La température du système est inférieure à 38° C (100° F). Non-respect de ces Les instructions peuvent entraîner des dommages matériels et / ou des blessures corporelles.

Caleffi ne pourra être tenue responsable des dommages résultant de la corrosion, d'une mauvaise utilisation ou une mauvaise utilisation des produits.

Dimensions

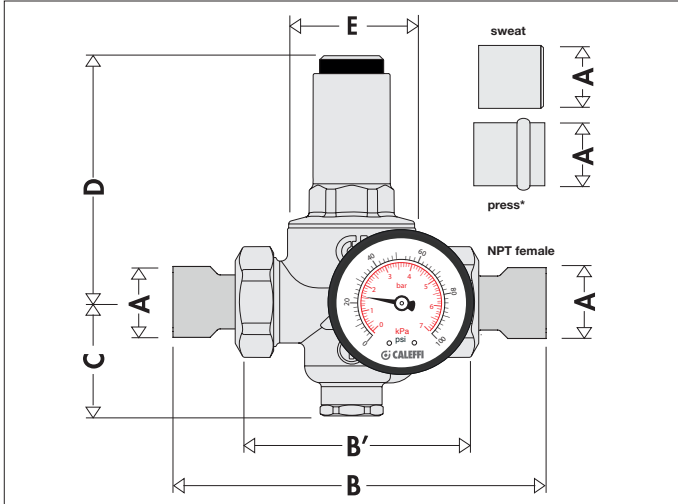


Code	A	B	B'	C	D	E	Wt. (lb.)
NPT Female threaded connections							
536044A 103	1/2"	5 1/2"	3"	2 1/8"	3 3/8"	2 1/8"	3.3
536054A 103	3/4"	6 1/4"	3 1/2"	2 1/8"	4 9/16"	2 1/8"	4.4
536064A 103	1"	6 7/8"	3 3/4"	2 1/8"	4 9/16"	2 1/8"	5.0
536074A 103	1 1/4"	7 7/8"	4 5/16"	2 1/2"	5 1/4"	2 1/2"	7.5
536084A 103	1 1/2"	8"	4 3/4"	2 1/2"	5 1/4"	2 1/2"	8.8
Press connections							
536044A 106	1/2"	5 1/2"	3"	2 1/8"	3 3/8"	2 1/8"	3.3
536054A 106	3/4"	6 3/16"	3 1/2"	2 1/8"	4 9/16"	2 1/8"	4.4
536064A 106	1"	7 3/4"	3 3/4"	2 1/8"	4 9/16"	2 1/8"	5.0
536074A 106	1 1/4"	8 13/16"	4 5/16"	2 1/2"	5 1/4"	2 1/2"	7.5
536084A 106	1 1/2"	12 1/2"	4 3/4"	2 1/2"	5 1/4"	2 1/2"	8.8
Sweat connections							
536044A 109	1/2"	5 5/8"	3"	2 1/8"	3 3/8"	2 1/8"	3.3
536054A 109	3/4"	5 9/16"	3 1/2"	2 1/8"	4 9/16"	2 1/8"	4.4
536064A 109	1"	6 7/8"	3 3/4"	2 1/8"	4 9/16"	2 1/8"	5.0
536074A 109	1 1/4"	6 5/8"	4 5/16"	2 1/2"	5 1/4"	2 1/2"	7.5
536084A 109	1 1/2"	7 3/4"	4 3/4"	2 1/2"	5 1/4"	2 1/2"	8.8

*Lay length
for press:

3 3/4 inch
4 3/16 inch
5 3/4 inch
6 7/8 inch
9 1/16 inch

Hydraulic characteristics

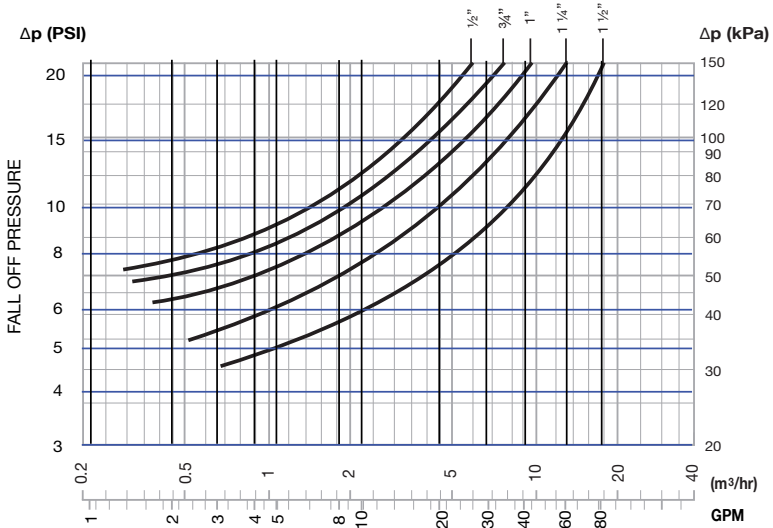

Reference values: Upstream pressure = 116 psi (800 kPa)
Downstream pressure = 43 psi (300 kPa))

	Design Flow Rate (6 ft per sec flow velocity)				
Size	1/2"	3/4"	1"	1 1/4"	1 1/2"
gpm	5.6	10	16	26	40
lpm	21	38	60	97	150
m ³ /hr	1.3	2.3	3.6	6.0	9.0


Installation:

The pressure reducing valve must be sized in accordance with the project documentation and flow rates determined by the designer. The pressure reducing valve must be installed by a licensed plumber and in accordance with relevant local requirements and following these instructions.

The installer must:

- install shut-off valves equipped with pressure ports or similar equipment which will facilitate measuring the system pressure;
- make sure the reducing valve is compatible with any other equipment in the system it may interact with or come into contact;
- assess and acknowledge all hazards related to the use of the product, including leaks, by installing the unit properly.

Mounting orientation:

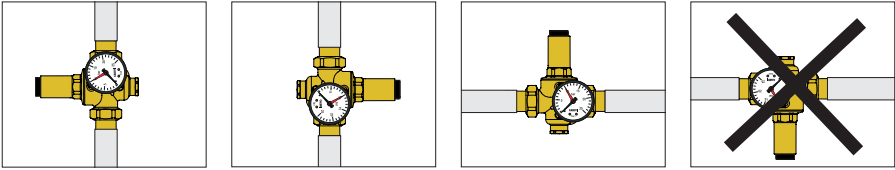


- 1) Before installing the pressure reducing valve, open all the outlets to flush the system and expel any air or debris in the piping system.
- 2) Install shut-off valves upstream and downstream to provide for maintenance.
- 3) The pressure reducing valve can be installed in either vertical or horizontal pipework. However it must not be installed upside down.
- 4) The pressure gauge may be installed on either side of the valve body. USE THE ADAPTER, do not screw the gauge directly into the valve body gauge tap. The gauge has MNPT threads and the valve body gauge tap is straight BSPP.
- 5) Check the required pressure on the downstream pressure gauge. Caleffi 536 Series low range pressure reducing valves come factory set at 45 psi (310 kPa).
- 6) Adjust the set point by means of the pressure regulating nut located under the top cover, turning with a 10 mm hexagonal Allen key to increase the set value or counter clockwise to reduce it.

Installation conditions:

When installed upstream of a hot water tank, installing an expansion tank is required to absorb the increase in pressure due to the thermal expansion of the heated water. To minimize the risk of cavitation, vibrations and noise in the PRV, the working conditions represented in the below diagram are highly recommended.

Due to numerous factors and variable conditions such as system pressure, water temperature, air presence, flow rate and velocity, which may affect the pressure reducing valve, the pressure ratio between the upstream pressure and the downstream set pressure should be kept around 2:1 and no greater than a value of 3:1 (For example, upstream 145 psi (1000 kPa), set pressure 73 psi (500 kPa), the pressure ratio = $145/73 = 2:1$). Under these conditions, the possible risk of cavitation and malfunction is minimized, however this does not exclude the possible effects of the many other variables within the system under operating conditions.



If the pressure ratio nears or exceeds the 3:1 limit, **use of a first stage pressure reducing valve** is highly recommended. The 536 Series “high range” is specifically designed to be a first stage valve. For example, first stage pressure reduction from 240 to 120 psi [1655 to 827 kPa] and then second stage from 120 to 60 psi [827 to 413 kPa]. Refer to the 536 Series high range installation instructions for details on two-stage applications.

Piping upstream and downstream of the pressure reducing valve must be supported in accordance with the manufacturer's instructions, along with any other local authority requirements, to avoid the creation and transfer of vibration and/or noise into the installation.

The inlet strainer of the pressure reducing valve should be periodically checked and cleaned, to minimize any partial or complete blockage which may limit the flow rate from the valve and/or create noise.

System flushing, cleaning and disinfection of the piping system in which the valve is installed shall be performed only by qualified personnel in accordance with the system component manufacturer's instructions, along with any other applicable local authority requirements. Exceeding the maximum stated chemical concentrations and/or duration of exposure may negatively impact the performance of the system and/or components installed such as the pressure reducing valve. Chemical dosed products must be chemically compatible with the pressure reducing valve materials of construction, specified in this instruction sheet.

Installation below ground:

If installing the PresCal HP 536 Series pressure reducing valve underground, protect the valve from becoming frozen in frost-prone areas. Allow sufficient space to remove the cartridge to perform required maintenance. Reading the pressure gauge for setting purposes may be difficult and an alternate means of checking downstream pressure may be necessary. Outdoor installation is acceptable in regions where freezing does not occur.




WARNING:

It is critical to maintain the downstream pressure setting to protect the plumbing system. As a safety measure, an expansion tank or safety relief valve should be installed downstream of the pressure reducing valve.


Maintenance:

The pressure reducing valve must be checked and serviced in compliance with the provisions of applicable regulations. Even when installed, commissioned and serviced properly, the pressure reducing valve's internal components are subject to normal wear and tear, which may result in leaks and other malfunctioning. Check that it is in good working order and service and clean the cartridge at least every 12 months.



For cleaning, inspection or replacement of the entire cartridge:

- 1) Isolate the pressure reducing valve.
- 2) Unscrew the spring pressure regulating nut to release the spring tension.
- 3) Remove the cover.



- 4) Extract the cartridge using two screwdrivers.
- 5) After inspection and cleaning if necessary, the complete cartridge can be re-installed or replaced using a spare cartridge.
- 6) Recalibrate the pressure reducing valve.

Troubleshooting:

1. Increased downstream pressure near a water heater.

This problem is due to the water being heated by the water heater. There is no relief of the pressure because the pressure reducing valve is correctly closed. The solution is to install an expansion vessel (between the heater and the reducer) to “absorb” the pressure increase or an expansion control valve to relieve the pressure.

2. The pressure reducing valve does not maintain its set pressure.

In most cases this is the result of impurities that deposit on the valve seat causing leakage with a resulting increase in pressure downstream. The solution is to fit a filter upstream from the reducer and subsequently to maintain and clean the cartridge (see Maintenance).



SAFETY

If the pressure reducing valve is not installed, commissioned and maintained properly in accordance with these instructions, it may not operate correctly, and may cause damage to objects and/or people. Make sure all the connections are watertight.

When installing the pressure reducing valve, make sure not to over-tighten the connections to the valve, as, over time, a failure can occur with subsequent water leakage causing damage.

In the case of highly aggressive water, treat the water before it enters the pressure reducing valve, in accordance with current legislation. Otherwise, the pressure reducing valve may be damaged and not function correctly.

Caleffi shall not be liable for damages resulting from stress corrosion, misapplication or misuse of its products.

Caleffi ne pourra être tenue responsable des dommages résultant de la corrosion, d'une mauvaise utilisation ou une mauvaise utilisation des produits.

LEAVE THIS MANUAL WITH THE USER.

Laissez ce manuel à la disposition de l'utilisateur.



Caleffi North America, Inc.
3883 West Milwaukee Road
Milwaukee, WI 53208

T: 414.238.2360 F: 414.238.2366

08-2023

**For Technical Support call 1-414-338-6338, or
email techsupport.us@caleffi.com**